

ANSI C37.46-2000
Revision of
ANSI C37.46-1981 (R1992)

American National Standard

For High Voltage Expulsion and Current-Limiting Type Power Class Fuses and Fuse Disconnecting Switches

Secretariat:

National Electrical Manufacturers Association

Approved May 3, 2000

American National Standards Institute, Inc.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

NOTICE AND DISCLAIMER

The information in this publication was considered technically sound by the consensus of persons engaged in the development and approval of the document at the time it was developed. Consensus does not necessarily mean that there is unanimous agreement among every person participating in the development of this document.

NEMA standards and guideline publications, of which the document contained herein is one, are developed through a voluntary consensus standards development process. This process brings together volunteers and/or seeks out the views of persons who have an interest in the topic covered by this publication. While NEMA administers the process and establishes rules to promote fairness in the development of consensus, it does not write the document and it does not independently test, evaluate, or verify the accuracy or completeness of any information or the soundness of any judgments contained in its standards and guideline publications.

NEMA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, application, or reliance on this document. NEMA disclaims and makes no guaranty or warranty, express or implied, as to the accuracy or completeness of any information published herein, and disclaims and makes no warranty that the information in this document will fulfill any of your particular purposes or needs. NEMA does not undertake to guarantee the performance of any individual manufacturer or seller's products or services by virtue of this standard or guide.

In publishing and making this document available, NEMA is not undertaking to render professional or other services for or on behalf of any person or entity, nor is NEMA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances. Information and other standards on the topic covered by this publication may be available from other sources, which the user may wish to consult for additional views or information not covered by this publication.

NEMA has no power, nor does it undertake to police or enforce compliance with the contents of this document. NEMA does not certify, test, or inspect products, designs, or installations for safety or health purposes. Any certification or other statement of compliance with any health or safety–related information in this document shall not be attributable to NEMA and is solely the responsibility of the certifier or maker of the statement.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

AMERICAN NATIONAL STANDARD

Approval of an American National Standard requires verification by ANSI that the requirements for due process, consensus, and other criteria for approval have been met by the standards developer.

Consensus is established when, in the judgment of the ANSI Board of Standards Review, substantial agreement has been reached by directly and materially affected interests. Substantial agreement means much more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that a concerted effort be made toward their resolution.

The use of American National Standards is completely voluntary; their existence does not in any respect preclude anyone, whether he has approved the standards or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standards.

The American National Standards Institute does not develop standards and will in no circumstances give an interpretation of any American National Standard. Moreover, no person shall have the right or authority to issue an interpretation of an American National Standard in the name of the American National Standards Institute. Requests for interpretations should be addressed to the secretariat or sponsor whose name appears on the title page of this standard.

Caution Notice: This American National Standard may be revised or withdrawn at any time. The procedures of the American National Standards Institute require that action be taken periodically to reaffirm, revise, or withdraw this standard. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute.

Published by

National Electrical Manufacturers Association
1300 North 17th Street, Rosslyn, VA 22209

© Copyright 2001 by the National Electrical Manufacturers Association
All rights reserved including translation into other languages, reserved under the Universal Copyright Convention, the Berne Convention for the Protection of Literary and Artistic Works, and the International and Pan American Copyright Conventions.

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Printed in the United States of America

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS Not for Resale

This page intentionally left blank.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

Contents

			Page
Foreword			v
1	General Scope		1
	1.1	Description of fuse enclosure packages using expulsion type indoor power class fuses	1
	1.2	Description of fuse enclosure packages using current-limiting type indoor power class fuses	2
2	Referenced and related standards		2
	2.1	Referenced American National Standards	2
	2.2	Other referenced standards	2
3	General rating information		2
	3.1	Ratings of power class fuse supports and fuse disconnecting switches	2
	3.2	Ratings of fuse holders, fuse units, refill units, and fuse links for power class fuses	3
	3.3	Preferred ratings and performance requirements	3
4	Design test requirements		5
	4.1	Dielectric tests	5
	4.2	Interrupting [breaking] tests	6
	4.3	Radio-influence tests	7
	4.4	Temperature rise tests	7
	4.5	Time-current tests	7
	4.6	Liquid tightness tests for liquid immersed current-limiting type power class fuses	7
5	Time-current-characteristic requirements for power class fuse refill units, fuse units, and fuse links		7
	5.1	Minimum melting and total clearing time-current characteristics for refill units, fuse units, and fuse links not assigned a specific letter designation	8
	5.2	Melting [pre-arcing] time-current characteristics for E-rated fuses	8
	5.3	Melting [pre-arcing] time-current characteristics for R-rated fuses	8

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

5.4 Identification for “E” or “R” rated fuse units, refill units, or fuse links…… 8

5.5 Melting current tolerance…… 9

6 Conformance tests for power class fuses…… 9

7 Construction requirements…… 9

7.1 Break distance of power class fuse supports and fuse disconnecting switches…… 9

7.2 Shipment of power class fuse supports…… 9

7.3 Base mounting dimensions…… 9

8 Nameplate marking…… 9

8.1 Fuse supports or fuse disconnecting switches..... 9

8.2 Fuse holders, Fuse links, Fuse units, or Refill units…… 9

9 Application requirements..... 10

9.1 Pole-to-pole [phase-to-phase] centerline spacings and clearances..... 10

9.2 Effects of ambient temperature on a fuse..... 10

9.3 Paralleling of fuses 12

Tables

1 Preferred Rated Symmetrical Interrupting Currents…… 13

2 Preferred Basic Impulse Insulation Level..... 14

3 Preferred Minimum Dielectric Withstand Test Voltage For Outdoor Power Uses..... 15

4 Preferred Minimum Dielectric Withstand Test Voltage For Indoor Power Class Fuses..... 16

5 Maximum Permissible Overvoltages For Current-Limiting Power Class Fuses..... 17

6 Radio-Influence Voltage Testing Parameters..... 18

7 Minimum Pole-To-Pole [Phase-To-Phase] Centerline Spacing For Outdoor Mounted Power Class Fuses (Except Expulsion Type) 19

8 Minimum Pole-To-Pole [Phase-To-Phase] Centerline Spacing For Outdoor Mounted Expulsion Type Power Class Fuses..... 19

9 Minimum Clearance Between Live Parts For Indoor Mounted Power Class Fuses..... 20

10 Minimum Allowable Continuous Currents For R-Rated Power Class Fuses..... 21

Figure 1 Preferred Base Mounting Dimensions..... 22

 © Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Foreword (This Foreword is not part of American National Standard C37.46-2000)

This standard is a revision of American National Standard Specifications for Power Fuses and Fuse Disconnecting Switches, ANSI C37.46-1981, to bring it up to date and in line with present day requirements for high-voltage fuses, fuse links, and fuse disconnecting switches.

This standard was prepared by the NEMA High Voltage Fuse Technical Committee with cooperation from the IEEE Subcommittee on High Voltage Fuses. Liaison was maintained with Edison Electric Institute (EEI) and International Electrotechnical Commission (IEC) during the development of the revisions in order to incorporate the latest thinking up to the time of publication.

This standard is one of a series of complementary standards covering various types of high-voltage fuses and switches, arranged so that certain standards apply to all devices while other standards provide additional specifications for a particular device. For any device, ANSI/IEEE C37.40-1993, IEEE ANSI/IEEE C37.41-2000, plus the additional standard covering that device, constitute a complete standard for the device. In addition, ANSI/IEEE C37.48-1997 is an application, operation, and maintenance guide for all the devices.

The following standards make up this series:

ANSI/IEEE C37.40-1993, *Service Conditions and Definitions for High-Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories*

ANSI/IEEE C37.41-2000, *Design Tests for High-Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories*

ANSI C37.42-1996, *Specifications for High Voltage Expulsion Type Distribution Class Fuses, Cutouts, Fuse Disconnecting Switches and Fuse Links*

ANSI C37.45-2000, *Specifications for High Voltage Distribution Class Enclosed Single-Pole Air Switches*

ANSI C37.46-2000, *Specifications for High Voltage Expulsion and Current-Limiting Type Power Class Fuses and Fuse Disconnecting Switches*

ANSI C37.47-2000, *Specifications for High Voltage Current-Limiting Type Distribution Class Fuses and Fuse Disconnecting Switches*

ANSI/IEEE C37.48-1997, *Guide for Application, Operation, and Maintenance of High Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories*

Suggestions for improvement of this standard will be welcome. They should be sent to the National Electrical Manufacturers Association, 1300 North 17th Street, Suite 1847, Rosslyn, VA 22209. Attention: Secretary ASC 37.

This standard was processed and approved for submittal to ANSI by Accredited Standards Committee on Power Switchgear, C37. Committee approval of the standard does not necessarily imply that all the committee members voted for its approval. At the time it approved this standard,the C37 Committee had the following members:

E. Byron, Chairman
A.K. McCabe, Executive Vice-Chairman, HV Standards
J. Scott, Executive Vice-Chairman, LV Standards
D.L. Swindler, Executive Vice-Chairman, IEC Activities
M. Calwise, Secretary

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Organizations Represented:	*Name of Representative:*
Electric Light and Power Group	D.E. Galicia J.L. Koepfinger G.J. Martuscello Y. Musa E. Worland
Institute of Electrical and Electronics Engineers	T. Burse K. Gray A. Monroe B. Puckett T.E. Royster R. Garzon (Alt) J.G. Wood (Alt)
National Electrical Manufacturers Association	G. Jones W. Long T. Olsen G. Sakats D. Stone E. Byron (Alt)
International Electrical Testing Association	A. Peterson
National Electrical Contractors Association	D. Harwood
Testing Laboratory Group	P. Notarian A. Harkness
Tennessee Valley Authority	D. Reynolds
U.S. Dept. of Agriculture	H.L. Bowles
U.S. Dept. Of the Army-Office of the Chief of Engineers	J.A. Gilson
U.S. Dept. of the Navy-Naval Construction Battalion Center.	D.L. Mills
Technical Liaison	W. Laubach C. Wagner

The NEMA High Voltage Fuse Technical Committee that developed this standard had the following membership:

R. Ranjan, Chairman
M. C. Calwise, Program Manager

M. Allison	T.A. Bellei	F.J. Muench
J. Angelis	G. Borchardt	N. Parry
L.R. Beard	S.P. Hassler	J.S. Schaffer

Other individuals who have contributed in the development of this standard are as follows:

J.G. Leach	J.R. Marek

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

For High Voltage Expulsion and Current-Limiting Type Power Class Fuses and Fuse Disconnecting Switches

1 General Scope

This standard establishes specifications for high voltage (above 1000 volts) expulsion and current-limiting type power class fuses, and accessories. All of these devices are intended for use on alternating current systems. These specifications apply to the following specific types of equipment:

a) Expulsion type power class fuses

b) Current-limiting type power class fuses

c) Power class fuse disconnecting switches

d) Expulsion and current-limiting type, indoor power class fuses, items (a) through (c), used in fuse enclosure packages (FEP) (see types listed in clauses 1.1 and 1.2 below)

e) Fuse supports, fuseholders, fuse hooks, fuse units, and refill units, of the type used exclusively with power class fuses and fuse disconnecting switches

f) Removable switch blades of the type used exclusively with power class fuses and fuse disconnecting switches

g) Fuse links of the type used exclusively with power class fuses and fuse disconnecting switches.

The power class expulsion fuses listed above are similar to those now covered in IEC 60282-2. These power class expulsion fuses are similar to their class "B" fuses. At present, ANSI/IEEE standards do not cover the class "C" fuses listed in the IEC standard. Some of the power class current-limiting type fuses listed above are similar to those now covered in IEC 60282-1. This ANSI standard contains specific requirements for more types of current-limiting fuses than IEC 60282-1. Use caution if devices specified and tested per ANSI/IEEE standards are compared to those specified and tested per IEC standards as they may or may not be the same.

In the headings and the text of this document there will be some areas where information is included in brackets [ ]. The information in the brackets is a term used in IEC standards that may be similar to the term we are using, a term that is common in some parts of the world, or is a term that has been used previously in ANSI and IEEE standards. Caution is again advised when making comparisons.

1.1 Description of Fuse Enclosure Packages Using Expulsion Type Indoor Power Class Fuses

Type 1E A fuse mounted in an enclosure with relatively free air circulation within the enclosure. (Examples - An Expulsion type fuse mounted in an enclosure or in a vault.)

Type 2E A fuse mounted in a container with restricted air flow surrounding the fuse, but relatively free air circulation within the enclosure on the outside surfaces of the container. (Example - An expulsion type fuse in an enclosure with insulating barriers that form a container that restricts the airflow.)

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS Not for Resale

Type 3E A fuse mounted in an enclosure, directly immersed in liquid, with relatively free liquid circulation around the fuse. (Example - An expulsion type fuse in a switchgear enclosure.)

1.2 Description of Fuse Enclosure Packages Using Current-Limiting Type Indoor Power Class Fuses

Type 1C A fuse mounted in an enclosure with relatively free air circulation within the enclosure. (Examples - A current-limiting type fuse mounted in a live front pad mounted transformer or in a vault.)

Type 2C A fuse mounted in a container with restricted airflow surrounding the fuse, but relatively free air circulation within the enclosure on the outside surfaces of the container. (Example - a current-limiting type fuse inside a canister in a vault.)

Type 3C A fuse mounted in a container with restricted airflow surrounding the fuse, but relatively free liquid circulation within the enclosure on the outside surfaces of the container. (Example - a current-limiting type fuse inside a canister immersed in transformer oil.)

Type 4C A combination of types 2 and 3, where the container is partially in air and partially in liquid. Example - a current-limiting type fuse inside a transformer bushing.)

Type 5C A fuse mounted in an enclosure, directly immersed in liquid, with relatively free liquid circulation around the fuse. (Example - an oil immersible current-limiting type fuse in a transformer or switchgear enclosure.)

2 Referenced and Related Standards

2.1 Referenced American National Standards

This standard is intended to be used in conjunction with the following American National Standards. When these referenced standards are superseded by a revision approved by the American National Standards Institute, Inc., the revision may not apply:

ANSI/IEEE C37.40-1993, *Service Conditions and Definitions for High-Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories.*

ANSI/IEEE C37.41-2000, *Design Tests for High-Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories.*

ANSI/IEEE C37.48-1997, *Guide for Application, Operation, and Maintenance of High-Voltage Fuses, Distribution Enclosed Single-Pole Air Switches, Fuse Disconnecting Switches, and Accessories.*

ANSI/IEEE C37.53.1-1989 (R1996), *Conformance Test Procedures for High Voltage Current-Limiting Motor Starter Fuses.*

2.2 Other Referenced Standards

IEC 60282-1-1994, *High Voltage Fuse - Part 1, Current-Limiting Fuses*

IEC 60282-2-1995, *High Voltage Fuse - Part 2, Expulsion Fuses*

3 General Rating Information

3.1 Ratings of Power Class Fuse Supports and Fuse Disconnecting Switches

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

The ratings of power class fuse supports and fuse disconnecting switches shall be determined with tests performed using the usual service conditions defined in clause 2 of ANSI/IEEE C37.40, except where other conditions are specified, and shall include:

a) Rated maximum voltage, determined by the rating of the fuse unit or insulator(s) employed therewith (whichever is lower); dielectric design tests specified in clause 4.1; and for fuse supports having fuse holders, the interrupting design tests specified in clause 4.2.

b) Rated continuous current, determined by temperature-rise design tests at rated continuous current as specified in clause 4.4.

c) Basic impulse insulation level (BIL) determined by the impulse withstand tests specified in clause 4.1.

3.2 Ratings of Fuse holders, Fuse Units, Refill Units, and Fuse Links for Power Class Fuses

The ratings of fuse holders, power fuse units, and fuse links for power class fuses shall be determined with tests performed using the usual service conditions defined in clause 2 of ANSI/IEEE C37.40, except where other conditions are specified, and shall include:

a) Rated maximum voltages, as specified in clause 3.3.1, and determined by the current interrupting design tests specified in clause 4.2.

b) Rated continuous current, determined by the temperature-rise design tests specified in 4.4 and, if applicable, in accordance with the preferred ratings listed in clause 3.3.3 and the time-current-characteristics specified in clauses 5.1, 5.2, and 5.3.

c) Rated frequency, as specified in clause 3.3.4.

d) Rated (maximum) interrupting current and rated minimum interrupting current as follows:

(1) Rated maximum interrupting current for fuse holders, fuse units, and refill units as specified in clause 3.3.5 and as determined by the current interrupting design tests specified in clause 4.2.

(2) Rated minimum interrupting current, for backup current-limiting power fuses, as specified in clause 3.3.6 and as determined by the current interrupting tests specified in clause 4.2.

Power class current-limiting fuses have three different sub-classes that depend on the fuse's low current interrupting capability. The three sub-classes are backup current-limiting fuses, general-purpose current-limiting fuses and full-range current-limiting fuses. Only backup current-limiting fuses have a rated minimum interrupting current. The other two types have low current capabilities as described in their definitions. Refer to ANSI/IEEE C37.40 for the definitions of these devices.

3.3 Preferred Ratings and Performance Requirements

3.3.1 Rated Maximum Voltage

The preferred rated maximum voltages for future designs of power class fuse supports, fuse disconnecting switches, fuse units, refill units, and fuse links shall be 2.8, 5.5, 8.3, 15.5, 17.2, 23.0, 27.0, 38.0, 48.3, 72.5, 121.0, 145.0, and 169.0 kV.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

The preferred rated maximum voltages for designs of power class fuse supports, fuse disconnecting switches, fuse units, refill units, and fuse links now being manufactured and in use shall be 2.8, 5.5, 8.3, 15.5, 17.0, 17.2, 25.8, 38.0, 48.3, 72.5, 121.0, 145.0, and 169.0 kV. Presently some "R" rated fuses have maximum voltages of 2.54 or 5.08(5.1) kV and some indoor fuses and disconnecting switches are rated 15.0 kV maximum.

The rated voltage of a power class fuse support and a fuse disconnecting switch shall correspond to the rated voltage of either the fuse unit or the supporting insulator unit, whichever is lower.

3.3.2 Rated Continuous Current For Power Class Fuse Supports and Fuse Disconnecting Switches

The preferred rated continuous current for power class fuse supports and fuse disconnecting switches shall be 10, 25, 100, 200, 300, 400, 450, 600, 700 and 720 amperes.

3.3.3 Rated Continuous Current For Power Class Fuse Units, Refill Units, and Fuse Links

The preferred rated continuous current for power class fuse units, refill units, and fuse links shall be 0.5, 1, 2, 3, 5, 7, 10, 15, 20, 25, 30, 40, 50, 65, 80, 100, 125, 150, 200, 250, 300 and 400 amperes.

"R" rated fuses are designated by the use of an R number and are not assigned a rated continuous current. Table 10 specifies the minimum allowable continuous current for each R rating at two ambient temperature conditions.

3.3.4 Rated Frequency

The preferred rated frequency for power class fuses shall be 50 Hz, 60 Hz, or both.

3.3.5 Rated Interrupting [Breaking] Current

The preferred rated maximum symmetrical interrupting currents of power class fuses in rms kiloamperes shall be in accordance with Table 1.

3.3.6 Rated Minimum Interrupting [Breaking] Current for Backup Current-Limiting Fuses

The rated minimum interrupting current for backup current-limiting power class fuses shall be designated by the manufacturer.

3.3.7 Rated Maximum Application Temperature [Rated Maximum Reference Ambient Temperature]

The rated maximum application temperature (rated maximum reference ambient temperature) is the maximum ambient temperature at which the device is suitable for use. The device must be capable of withstanding this temperature without any deterioration that would inhibit its ability to properly interrupt the circuit. The minimum rating allowable is 40^{o}C. The rated maximum application temperature of the device in degrees C shall be preferably selected from the R20 series of preferred numbers (typically 40, 45, 50, 56, 63, 71 etc.). The R20 series is comprised of the numbers 1, 1.12, 1.25, 1.40, 1.60, 1.80, 2.00, 2.24, 2.50, 2.80, 3.15, 3.55, 4.00, 4.50, 5.00, 5.60, 6.3, 7.10, 8.00, 9.00 and their multiples of 10.

3.3.8 Basic Impulse Insulation Level (BIL)

The preferred basic impulse insulation level of power class fuses shall be as specified in Table 2.

3.3.9 Power Class Fuse Performance Requirements

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

3.3.9.1 Performance Requirements of Power Class Fuse Supports and Fuse Disconnecting Switches

The preferred performance requirements of power class fuse supports and fuse disconnecting switches shall include:

a) Power-frequency dry-withstand voltages for outdoor and indoor power class fuses, as specified in clause 4.1.

b) Power-frequency wet-withstand voltages for outdoor power class fuses, as specified in clause 4.1.

c) Power-frequency dew-withstand voltages for indoor power class fuses used in fuse enclosure packages (FEP) as specified in clause 4.1.

d) Impulse withstand voltages for outdoor and indoor power class fuses, as specified in clause 4.1

e) Temperature Rise limitations as specified in clause 4.4.

f) Radio-influence voltage, as specified in clause 4.3.

3.3.9.2 Performance Requirements of Fuse Units, Refill Units, and Fuse Links For Power Class Fuses

The performance requirements of fuse units, refill units, and fuse links for power class fuses shall include:

a) Melting [pre-arcing] time-current characteristic. Time-current-characteristic requirements specified in clause 5 and determined as specified in clause 4.5.

b) Total clearing-time-current characteristics, determined as specified in clause 4.5.

c) Maximum peak overvoltages for current limiting fuses determined as specified in clause 4.2.2.

d) Peak let-through [cut-off] current characteristics, for current-limiting fuses, determined as specified in clause 4.2.3.

3.3.10 Ratings and Performance Requirements Other Than Preferred

Special circuit or environmental conditions may require devices with ratings or performance requirements that are different from the preferred values specified above. For these devices the ratings and the performance requirements shall be agreed upon by the user and the manufacturer.

4 Design Test Requirements

4.1 Dielectric Tests

4.1.1 Outdoor Power Class Fuses

Outdoor power class fuses shall be capable of withstanding the test voltages specified in table 3 when tested as specified in clause 5 of ANSI/IEEE C37.41.

4.1.2 Indoor Power Class Fuses Used In Fuse Enclosure Packages (FEP)

Indoor power class fuses used in fuse enclosure packages shall be capable of withstanding the test voltages specified in Table 4 when tested as specified in clause 5 of ANSI/IEEE C37.41.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

4.2 Interrupting [Breaking] Test

Power class fuses when tested as specified in clause 6 of ANSI/IEEE C37.41 shall be capable of interrupting all currents from low current up to and including the rated interrupting current of the device, with any degree of asymmetry associated with the specified X/R ratio. For expulsion fuses the low current is the current that will melt the element in the long time range (300 seconds minimum).

For current-limiting general-purpose fuses, the low current is the current that causes the fuse to melt in not less than one hour. For full-range current-limiting fuses it is the minimum test current determined for the series 3 tests and for backup fuses it is the minimum interrupting rating [minimum breaking current] assigned by the manufacturer.

For power class fuses that use replaceable fuse links the fuse shall be capable of interrupting these currents with any type and size of link recommended by the manufacturer and as specified below:

a) For all fuses with a continuous current rating of 100 amperes and below, any link size with a current rating of 1 through 100 amperes.

b) For all fuses with a continuous current rating of 200 amperes and above, any link size from greater than 100 amperes up through the continuous current rating of the device.

4.2.1 Test Requirements and Test Circuit Parameters

The tests required and the test circuit parameters are as listed below:

Device	ANSI/IEEE C37.41	
	Test Clause	Tables
Expulsion type power class fuses	6.5	9,10 & 11
Expulsion type power class fuses used in air insulated enclosure packages	6.9	—
Expulsion type power class fuses used in liquid filled enclosure packages	6.8	13 & 7
Expulsion type power class fuses used for the protection of shunt capacitors (a)	6.10 (6.10.2, 6.10.3, & 6.10.4)	10, 14, 15 & 16
Current-limiting type power class fuses	6.6	12 & 10
Current-limiting type power class fuses used in air insulated, liquid filled or combination enclosure packages	6.7	—
Current-limiting type power class fuses used for the protection of shunt capacitors*	6.10 (6.10.2, 6.10.3, & 6.10.4)	10, 14, 15 & 16

*If these devices are used in enclosures the additional testing required for devices used in enclosures may be required.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

4.2.2 Peak Overvoltage For Current-Limiting Type Power Class Fuses

Peak overvoltages for current-limiting type power class fuses, as determined in accordance with clause 6 of ANSI/IEEE C37.41, shall not exceed the values specified in Table 5.

4.2.3 Peak Let-Through [Cut-off] Current

Peak let-through [cut-off] current for current-limiting type power class fuses shall be determined as specified in clause 6 of ANSI/IEEE C37.41.

4.3 Radio-Influence Tests

Power class fuses, when new, clean and tested at the point of manufacture as specified in clause 9 of ANSI/IEEE C37.41 shall be capable of meeting the limits of radio-influence voltage at the test voltage specified in Table 6.

4.4 Temperature Rise Tests

Power class fuses and power class disconnecting switches, when tested as specified in clause 11 of ANSI/IEEE C37.41, shall not exceed the temperature rise and total temperature values specified in Table 2 of ANSI/IEEE C37.40 when the device is carrying rated continuous current and the test's ambient temperature is within the allowable range specified. Fuse devices being tested shall be fused with the maximum rated fuse unit, refill unit or fuse link that is used in the device being tested. Disconnecting switches shall be equipped with a disconnecting blade designed for the device or a blade recommended by the manufacturer.

Clause 11 of ANSI/IEEE C37.41 covers testing of devices used at ambient temperatures of 40°C and below. For higher ambient temperatures consult the manufacturer.

4.5 Time-Current Tests

The minimum melting and total clearing time-current curves for power fuse units, refill units, and fuse links shall be determined as specified in clause 12 of ANSI/IEEE C37.41. A sufficient number of tests shall be made to ensure that all fuse units, refill units, and fuse links meet the melting current tolerance specified in clause 5.5.

4.6 Liquid Tightness Tests For Liquid Immersed Current-Limiting Type Power Class Fuses

Current-limiting type power class fuses immersed in a liquid in an enclosure shall be capable of withstanding the liquid tightness tests specified in clause 14 of ANSI/IEEE C37.41. Devices requiring this test are listed as type 5C in clause 1.2.

NOTE: If a current-limiting fuse is used in a fuse enclosure package (FEP) such as those listed in clause 1.2 types 3C and 4C, it is recommended that appropriate tests be performed to ensure that the fuse being used will not be inadvertently subjected to submersion in the liquid that surrounds the container during the containers service lifetime.

5 Time-Current-Characteristic Requirements For Power Class Fuse Refill Units, Fuse Units, and Fuse Links

To comply with this standard, power class fuse refill units, fuse units and fuse links are not required to meet any particular time-current characteristic. Some fuse refill units, fuse units or fuse links have been designed to comply with the melting characteristics that have been designated as "E" or "R" rated. An "E" rating, specifies a range of currents that an individual fuse must melt at for one particular time. An "R" rating specifies a range of time for the fuse melting at one particular current value. The assignment of an "E" or "R" rating to a fuse does not make any particular "E" or "R" fuse interchangeable with any other

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS Not for Resale

particular fuse having this rating since the shape of the curves may be significantly different. The slope and shape of the melting curve is determined by the design of the current responsive element and is a distinctive feature of each manufacturer.

5.1 Minimum Melting and Total Clearing Time-Current Characteristics For Refill Units, Fuse Units, and Fuse Links Not Assigned a Specific Letter Designation

Refill units, fuse units, and fuse links for power fuses are available that meet and comply with this standard except that the melting time-current-characteristics differ from either the E or R types listed below, or the rated continuous current differs from that specified in clause 3.3.3 or both. The ratings and/or the time-current-characteristics for these devices provide desirable properties for many applications.

Since the current responsive element is a distinctive feature of each manufacturer, the minimum melting times and the total clearing times for these fuses shall be shown on each manufacturer's published time-current-characteristic curves.

5.2 Melting [Pre-arcing] Time-Current Characteristics for E-Rated Fuses

The melting-time-current-characteristics of fuse units, refill units, and fuse links for power fuses designated as E-rated shall be as follows:

a) The current-responsive element for fuses with a rated continuous current of 100 amperes or below shall melt in 300 seconds at an rms current within the range of 200% to 240% of the continuous current rating of the device.

b) The current-responsive element for fuses with a rated continuous current above 100 amperes shall melt in 600 seconds at an rms current within the range of 220% to 264% of the continuous current rating of the device.

c) The minimum melting-time-current characteristics of a power fuse at any current higher than the 200% to 240% or 264% specified in a) or b) above shall be shown by each manufacturer's published time-current curves, since the current-responsive element is a distinctive feature of each manufacturer.

5.3 Melting [pre-arcing] Time-Current Characteristics for R-Rated Fuses

The melting-time-current-characteristics of fuse units, refill units, and fuse links for power fuses designated as R-rated shall be as follows:

a) The fuse shall melt in a range of 15 to 35 seconds at a value of current equal to 100 times the R number.

b) The minimum melting-time-current characteristics of an R-rated fuse at any current higher than the value of 100 times the R number specified in a) shall be shown by each manufacturer's published time-current curves, since the current-responsive element is a distinctive feature of each manufacturer.

c) Power class R-rated current-limiting type fuses are backup type current-limiting fuses that are used with high-voltage motor starters to increase the interrupting rating of the combined package. Time current curves shall be shown in the time range of 0.01 seconds to 100 seconds for power class, R-rated, current-limiting fuses.

5.4 Identification For "E" or "R" Rated Fuse Units, Refill Units or Fuse Links

Fuse units, refill units, or fuse links for power class fuses that are identified by the letter "E" or "R", shall have melting-time-current characteristics that conform to the requirements specified in clause 5.2, or clause 5.3.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

5.5 Melting Current Tolerance

For all types of power class fuse refill units, fuse units or fuse links the maximum melting current shall not exceed the minimum melting current by more than 20% for any given melting time.

6 Conformance Tests for Power Class Fuses

For all power class fuses, except current-limiting motor-starter fuses, the conformance tests, as defined in clause 3 of ANSI/IEEE C37.40, shall consist of a power-frequency dry-withstand voltage test on the fuse support. The test shall be conducted as specified in clause 5 of ANSI/IEEE C37.41. For current-limiting motor-starter fuses, the conformance test shall be in accordance with ANSI/IEEE C37.53.1.

7 Construction Requirements

7.1 Break Distance of Power Class Fuse Supports and Fuse Disconnecting Switches

The break distance of outdoor and indoor power class fuse supports or fuse disconnecting switches, when in the full open position or with the fuse holder or fuse unit removed, shall be at least 10% in excess of the dry-arcing distance over the insulators and shall be such that the break distance between live parts shall withstand the test voltages specified in clause 4.1.1 or clause 4.1.2 for break distance.

7.2 Shipment of Power Class Fuse Supports

Power class fuse supports shall be shipped completely assembled with insulators if the supports are rated 48.3 kV or below; insulators for supports rated above 48.3 kV shall be shipped separately.

7.3 Base Mounting Dimensions

Preferred dimensions for the base mounting holes for outdoor power class fuses are shown in Fig. 1. Base mounting holes shall not be less than 1.43 cm (9/16 inch) in diameter.

8 Nameplate Marking

8.1 Fuse Supports or Fuse Disconnecting Switches

The following minimum information shall be placed on the fuse supports or fuse disconnecting switches:

a) Manufacturer's name or trademark (or monogram).

b) Manufacturer's type or other product identification.

c) Rated continuous current (maximum sizes of fuse units, refill units, or fuse links to be used).

d) Rated maximum voltage.

e) Basic impulse insulation level (BIL).

8.2 Fuse Holders, Fuse Links, Fuse Units, or Refill Units

The following minimum information shall be placed on the fuse holders, fuse units, refill units, or on the shipping containers. The minimum information to be placed on fuse links or their shipping containers is a), b), c), and d). The minimum information that shall appear on the fuse holders, fuse units, and refill units is indicated by an asterisk(*). The minimum information that shall appear on the fuse links is indicated by an (x).

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS Not for Resale

a) Manufacturer's name or trademark (or monogram).(*)(x)

b) Manufacturer's type or other product identification of the fuses, fuse supports or disconnecting switches for which the fuse units, refill units or fuse links are designed.

c) Manufacturer's type or identification letter for the fuse unit, refill unit or fuse link. This identification shall follow the rated continuous current marking (E, R or other identifications where applicable).(*)(x)

d) Rated continuous current.(*)(x)

e) Rated maximum voltage.(*)

f) Rated interrupting current.(*)

g) Rated minimum interrupting current (for backup current-limiting type power class fuses only)

h) Rated frequency.

9 Application Requirements

See ANSI/IEEE C37.48 for general application guidelines.

9.1 Pole-to-Pole [Phase-to-Phase] Centerline Spacings and Clearances

9.1.1 Outdoor Mounted Power Class Fuses, Except Expulsion Type

The minimum pole-to-pole [phase-to-phase] centerline spacings for outdoor mounted power class fuses, except those of the expulsion type, should be in accordance with Table 7 in the absence of specific manufacturer's recommendations.

9.1.2 Outdoor Mounted Expulsion Type Power Class Fuses

The minimum pole-to-pole [phase-to-phase] centerline spacings for outdoor power fuses of the expulsion type should be as specified in Table 8 in the absence of specific manufacturer's recommendations.

9.1.3 Indoor Mounted Power Class Fuses

The minimum clearance between live parts pole-to-pole [phase-to-phase] for indoor mounted power class fuses shall be as specified in Table 9 in the absence of specific manufacturer's recommendations.

9.2 Effects of Ambient Temperature on a Fuse

9.2.1 Rated Maximum Application Temperature

Fuses which are designed for outdoor use and tested to ANSI/IEEE C37.41, and this standard, are suitable for continuous use in an ambient temperature of up to 40°C. However, the standards also include fuses for use in enclosures, some of which subject the fuse to higher temperatures or other conditions which require additional testing. Fuses designed and tested for use in enclosures are assigned a Rated Maximum Application Temperature (RMAT) [maximum reference ambient temperature], which must be at least 40°C. A current-limiting fuse in a fuse enclosure package (FEP) has to demonstrate successful current interruption at the RMAT assigned by the FEP manufacturer. In-air expulsion fuses used in enclosures are also required to demonstrate successful interruption in such enclosures. The tests are performed at normal test ambient temperature (between 10°C and 40°C) if the assigned RMAT is 55°C or less, and at the RMAT if it is higher than 55°C. The rated maximum application temperature is thus the highest ambient temperature of the fluid in contact with the fuse or FEP for which the manufacturer rates

 © Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

the device as being suitable for interrupting current. The elevated ambient temperature may be caused by factors, or a combination of factors, such as solar heating, heat from the fuse and/or other equipment in the enclosure, or restriction of cooling fluid by the enclosure. It is important to note that if a fuse is used in an ambient temperature higher than its RMAT, it may not interrupt the current when its element(s) melt.

9.2.2 Rated Continuous Current and Allowable Continuous Current

Fuses designed and tested to current standards are required to carry a current at least equal to their rated continuous current in an ambient temperature of up to 40°C without exceeding the maximum temperatures specified in Table 2 of ANSI/IEEE C37.40. It should be noted, however, that some older designs of expulsion fuses use an ambient temperature of 30°C as a basis for their rated continuous current. Fuses may not be able to carry this current (nameplate rating or rating marked on the fuse) if they are used in some form of enclosure, or if the ambient temperature is over 40°C (30°C for some older designs). The current a fuse can carry continuously under these different circumstances, without exceeding the specified temperatures, is defined as its allowable continuous current. This current is linked to a specific ambient temperature. Such a rating, when the fuse is a part of an FEP, should be available from the FEP manufacturer, or often the fuse manufacturer. It would normally be in the form of de-rating (re-rating) factors applied to the fuse's rated continuous current, and will allow for the effect of enclosure and/or ambient temperature. Alternatively, a table of current ratings related to temperature may be supplied.

In some cases, the RMAT assigned to a fuse may be higher than the maximum temperatures permitted in Table 2 of ANSI/IEEE C37.40. This is because it may be anticipated that, in practice, the RMAT will occur in equipment experiencing severe overload or failure conditions. In this case, the fuse cannot be assigned an allowable continuous current at its RMAT, since the permitted temperatures would be exceeded even without taking into account any temperature rise caused by current in the fuse. It cannot, therefore, be assumed that a fuse will have an allowable continuous current at its RMAT. In some cases, fuses will only be assigned such a current rating at a lower temperature where they would be expected to operate continuously.

There are some circumstances under which a fuse may be required, and is able, to carry a particular continuous current at some ambient temperature, or in an enclosure, which produces temperatures in excess of those specified in Table 2 of ANSI/IEEE C37.40. In this case, the application should be by agreement between the manufacturer and user. It is worth noting that some of these temperatures are based on spring contact temperatures in air, while fuses in enclosures may use bolted contacts and/or contacts in fluid, which may allow for successful operation at higher temperatures.

9.2.3 Time Current Characteristics

The time current characteristic (TCC) curve of a fuse is determined at 25°C ± 5°C. Ambient temperatures which differ from this may cause a shift in the TCC, with higher temperatures causing the fuse to melt faster for a given current. Other factors which can affect the TCC include changes in heat transfer caused by an enclosure or container and the type of cooling medium (for example air or oil). The degree of change to a fuse's TCC is a function of the individual fuse design, and is different for different types of fuse. When the fuse is a part of an FEP, details of the resulting effect on the TCC should be available from the FEP manufacturer. It is normally in the form of multiplying factors applied to the fuse's TCC allowing for the effect of the enclosure and/or ambient temperature. The most significant area of concern is usually change to the long time melting characteristics of fuses, since this may change the way a fuse is affected by an overload. This is usually of significance to general-purpose and full-range current-limiting fuses, while the change in TCC is usually much less significant for backup fuses.

9.2.4 Fuse Selection

The effects of ambient temperatures less than 25°C generally do not have to be considered, as these temperatures produce longer melting times than those shown on the minimum melting TCC curves, and the operating temperatures are less than those obtained during the temperature rise tests. In most

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS Not for Resale

applications between 25°C and 40°C, the effects of ambient temperature do not have to be considered since the decrease in melting current is generally less than 5% and most coordinating margins are greater than this. However, if a fuse is to be used at an ambient temperature over 40°C, or in an FEP, it is important to assess the effect of the environment on the fuse. The actual maximum application temperature should be compared to the fuse's RMAT and the effect on current rating and TCC are also relevant. It is important that conditions are not such as to cause deterioration of the fuse and associated components; an example of such a condition would be overloading backup and general-purpose current limiting fuses, and some types of expulsion fuse. It is also very important to ensure that changes in the fuse's TCC do not result in a fuse being called upon to interrupt a current for which it is not designed and tested. Attention should, therefore, be given to fuse coordination under all anticipated ambient temperature conditions. In ANSI/IEEE C37.48 there is some discussion concerning the use of de-rating factors for a current-limiting fuse's TCC when the fuse is used in a container or enclosure.

9.3 Paralleling of Fuses

Power class fuses should not be paralleled unless they have been tested in parallel. Parallel fuses should be considered a separate design and tested accordingly. Consult the fuse manufacturer for this application.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

© Copyright 2001 by NEMA

Table 1 – Preferred Rated Symmetrical Interrupting Currents

Maximum Rated Voltage (kV) (d)																					
2.54 - 2.80		**5.08 - 5.5**		**8.3**		**15.0 - 17.2**		**23.0 - 27.0**		**38.0**		**48.3**		**72.5**		**121.0**		**145.0**		**169.0**	
Rated Interrupting Current (kA – rms) (a) (b) (c)																					
Sym	**Asym**	**Sym**	Asym	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**	**Sym**	**Asym**
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1.25	2.0		2.0	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	2.5	4.0	2.5	4.0	1.25	4.0	2.5	4.0
-	-	-	-	-	-	-	-	-	-	-	-	3.15	5.0	-	-	-	-	2.5	-	-	-
-	-	-	-	4.0	6.3	4.0	6.3	4.0	6.3	-	-	4.0	6.3	4.0	6.3	4.0	6.3	-	6.3	4.0	6.3
-	-	-	-	5.0	8.0	5.0	8.0	5.0	8.0	5.0	8.0	5.0	8.0	5.0	8.0	5.0	8.0	4.5	8.0	5.0	8.0
-	-	-	-	6.3	10.0	6.3	10.0	6.3	10.0	6.3	10.0	6.3	10.0	6.3	10.0	6.3	10.0	5.0	10.0	6.3	10.0
-	-	-	-	8.0	12.5	8.0	12.5	8.0	12.5	8.0	12.5	8.0	12.5	8.0	12.5	8.0	12.5	6.3	12.5	8.0	12.5
-	-	-	-	10.0	16.0	10.0	16.0	10.0	16.0	10.0	16.0	10.0	16.0	10.0	16.0	10.0	16.0	8.0	16.0	10.0	16.0
-	-	-	-	12.5	20.0	12.5	20.0	12.5	20.0	12.5	20.0	12.5	20.0	12.5	20.0	12.5	20.0	10.0	20.0	12.5	20.0
-	-	-	-	16.0	25.0	16.0	25.0	16.0	25.0	16.0	25.0	16.0	25.0	16.0	25.0	16.0	25.0	12.5	-	-	-
-	-	-	-	20.0	31.5	20.0	31.5	20.0	31.5	20.0	31.5	20.0	31.5	20.0	31.5	-	-	-	-	-	-
-	-	-	-	25.0	40.0	25.0	40.0	25.0	40.0	25.0	40.0	25.0	40.0	25.0	40.0	-	-	-	-	-	-
31.5	50.0	31.5	50.0	31.5	50.0	31.5	50.0	31.5	50.0	31.5	50.0	31.5	50.0	-	-	-	-	-	-	-	-
40.0	63.0	40.0	63.0	40.0	63.0	40.0	63.0	40.0	63.0	40.0	63.0	-	-	-	-	-	-	-	-	-	-
50.0	80.0	50.0	80.0	50.0	80.0	50.0	80.0	50.0	80.0	-	-	-	-	-	-	-	-	-	-	-	-
63.	100.0	-	-	-	-	63.0	100.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	80.0	125.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-

NOTES—

(a) Asymmetrical values are provided for information only.
(b) Ratios of asymmetrical to symmetrical currents are between 1.56 and 1.6.
(c) Rated interrupting currents are selected from the R10 series of preferred numbers.
The R10 series is comprised of the numbers 1, 1.25, 1.60, 2.00, 2.50, 3.15, 4.00, 5.00, 6.30, 8.00, and their multiples of 10.
(d) See 3.3.1.

--`,,`,,`-`-`,,`,,`,`,,`---

Not for Resale

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Table 2 – Preferred Basic Impulse Insulation Level

Rated Maximum Voltage (a) (kV, rms)	Basic Impulse Insulation Level (kV, crest)
Outdoor Power Class Fuses	
8.3	95
15.5 - 17.2	110
23.0 - 27.0	150
38.0	150
38.0	200
48.3	250
72.5	350
121.0	550
145.0	650
169.0	750
Indoor Power Class Fuses	
2.54 - 2.8	45
5.08 - 5.5	60
8.3	75
15 - 17.2	95
15.5 - 17.2	110
23 - 27	125
23.0 - 27.0	150
38.0	150
38.0	200

NOTE— (a) See clause 3.3.1

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

© Copyright 2001 by the National Electrical Manufacturers Association

Table 3 – Preferred Minimum Dielectric Withstand Test Voltage for Outdoor Power Class Fuses

Minimum Withstand Voltages					
	Terminal-to-Ground for all Devices and Pole-to-Pole (Phase-to-Phase) for Multipole Devices			Terminal-to-Terminal	
Rated Maximum Voltage (a) (kV, rms)	Power-Frequency Dry Test, 1 min (kV, rms)	Power-Frequency Wet Test, 10 Seconds (b) (kV, rms)	Impulse Test, 1.2 x 50 microseconds (kV, crest)	Power-Frequency Dry Test, 1 min (kV, rms)	Impulse Test, 1.2 x 50 microseconds (kV, crest)
8.3	35	30	95	39	105
15.5 - 17.2	50	45	110	55	121
23.0- 27.0	70	60	150	77	165
38.0	70	60	150	77	165
38.0	95	80	200	105	220
48.3	120	100	250	132	275
72.5	175	145	350	193	385
121.0	280	230	550	308	605
145.0	335	275	650	368	715
169.0	385	315	750	424	825

NOTES—

(a) See clause 3.3.1.

(b) Power-frequency wet-withstand test voltages on the insulators that meet these values will be satisfactory in lieu of this test, provided the design of the complete device does not decrease the power-frequency withstand test voltages of the insulators.

Not for Resale

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Table 4 – Preferred Minimum Dielectric Withstand Test Voltage for Indoor Power Class Fuses

Rated Maximum Voltage (a) (kV, rms)	Minimum Withstand Voltages				
	Terminal-to-Ground for all Devices and Pole-to-Pole (Phase-to-Phase) for Multipole Devices			Terminal-to-Terminal	
	Power-Frequency Dry Test, 1 min (kV, rms)	Power-Frequency Dew Test, 10 seconds (b)(c)(d) (kV, rms)	Impulse Test, 1.2 x 50 microseconds (kV, crest)	Power-Frequency Dry Test, 1 min (kV, rms)	Impulse Test, 1.2 x 50 microseconds (kV, crest)
2.54 - 2.8	15	10	45	17	50
5.08 - 5.5	19	15	60	21	66
8.3	26	24	75	29	83
15.0 - 17.2	36	26	95	40	105
15.5 - 17.2	50	30	110	55	121
23.0 - 27.0	42	28	125	47	138
23.0 - 27.0	60	40	150	66	165
38.0	70	40	150	77	165
38.0	95	80	200	105	220

NOTES—

(a) See clause 3.3.1.

(b) Power-frequency dew-withstand test voltages on the insulators that meet these values will be satisfactory in lieu of this test, provided the design of the complete device does not decrease the power-frequency withstand test voltages of the insulators.

(c) When fuse enclosure packages use a liquid or a gas other than air for its dielectric medium, the dew test is not required.

(d) When fuse enclosure packages use air for its dielectric medium, multipole devices require dew tests pole-to-pole only when there is solid type insulation between the poles.

© Copyright 2001 by the National Electrical Manufacturers Association

Not for Resale

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Table 5 – Maximum Permissible Overvoltages for Current-Limiting Type Power Class Fuses

Rated Maximum Voltage (a) (kV, rms)	Maximum Peak Overvoltages (kV, crest)	
	0.5 to 12 Amperes	Over 12 Amperes
2.54 - 2.8	13	9
5.08 - 5.5	25	18
8.3	38	26
15.0 - 17.2	68	47
15.5 - 17.2	70	49
23.0	105	72
25.8	117	81
27.0	123	84
38.0	173	119

NOTES—(a) See clause 3.3.1.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 6 – Radio-Influence Voltage Testing Parameters

Rated Maximum Voltage(a) (kV, rms)	Minimum Test Voltage (b) (volts, rms)	Maximum Allowable Radio-Influence Voltage (μV at 1 MHz)
2.54 - 2.8	1,700	500
5.08 - 5.5	3,340	500
8.3	5,030	500
15.0 - 15.5	9,410	500
17.2	9,930	500
23.0	13,950	500
25.8	15,900	650
27.0	16,400	650
38.0	23,000	650
48.3	29,300	1,250
72.5	44,000	1,250
121.0	73,400	2,500
145.0	88,000	2,500
169.0	102,500	2,500

NOTES—

(a) See clause 3.3.1.

(b) For power class fuses the minimum test voltage is based on line-to-line applications with voltages equal to or less than the devices rated maximum voltage. If the device is designed to be applied in line-to-ground applications at its rated maximum voltage, the test voltage shall be 1.05 times the rated maximum voltage.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 7 – Minimum Pole-to-Pole [Phase-to-Phase] Centerline Spacing for Outdoor Mounted Power Class Fuses (except expulsion Type) (b)

Rated Maximum Voltage (a) (kV rms)	Minimum Pole-to-Pole (Phase-to-Phase) Centerline Spacing	
	Inches	Centimeters
8.3	18	46
15.5 - 17.2	24	61
23.0 - 27.0	30	76
38.0	36	91
48.3	48	122
72.5	60	152
121.0	84	213
145.0	96	244
169.0	108	274

NOTES—

(a) See clause 3.3.1.
(b) To be used in the absence of specific manufacturer's recommendations.

Table 8 – Minimum Pole-to-Pole [Phase-to-Phase] Centerline Spacing for Outdoor Mounted Expulsion Type Power Class Fuses (b)

Rated Maximum Voltage (a) (kV rms)	Minimum Pole-to-Pole (Phase-to-Phase) Centerline Spacing	
	Inches	Centimeters
8.3	36	91
15.5 - 17.2	36	91
23.0 - 27.0	48	122
38.0	60	152
48.3	72	183
72.5	84	213
121.0	120	305
145.0	144	366
169.0	168	427

NOTES—

(a) See clause 3.3.1.
(b) To be used in the absence of specific manufacturer's recommendations.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 9 – Minimum Clearance Between Live Parts for Indoor Mounted Power Class Fuses

Rated Maximum Voltage (a) (kV rms)	Minimum Clearance between Live Parts Pole-to-Pole (Phase-to-Phase) (b)(c)(d)(e)	
	Inches	Centimeters
2.54 - 2.8	3.5	9
5.08 - 5.5	4.5	11
8.3	6.0	15
15.0	7.5	19
15.5 - 17.2	9.0	23
23.0 - 27.0	13.0	33
38.0	18.0	46

NOTES—

(a) See clause 3.3.1.

(b) Fuses that eject expulsion products may require greater clearances.

(c) Barriers may be used to facilitate insertion or removal of fuse units. Provision of adequate insulating barriers may result in modification of these clearances.

(d) When fuses are mounted in equipment covered by other standards, minimum electrical clearances may be modified in accordance with those standards.

(e) To be used in the absence of specific manufacturer's recommendations.

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale


Table 10 – Minimum Allowable Continuous Currents for R-Rated Power Class Fuses

Fuse Designations (a)	Allowable Continuous Current (amperes)	
	At 55°C Ambient	At 40°C Ambient
1.5 R	36	40
2.0 R	63	70
3.0R	90	100
4.0R	115	130
5.0R	135	150
6.0R	150	170
9.0R	180	200
12.0R	210	230
18.0R	350	390
24.0R	400	450
26.0R	430	480
30.0R	490	550
32.0R	540	600
36.0R	580	650
38.0R	630	700

NOTES—(a) Fuses above 38R are available. Since these are special designs consult the manufacturer for continuous current values.

--`,,`,,`-`-`,,`,,`,`,,`---
© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

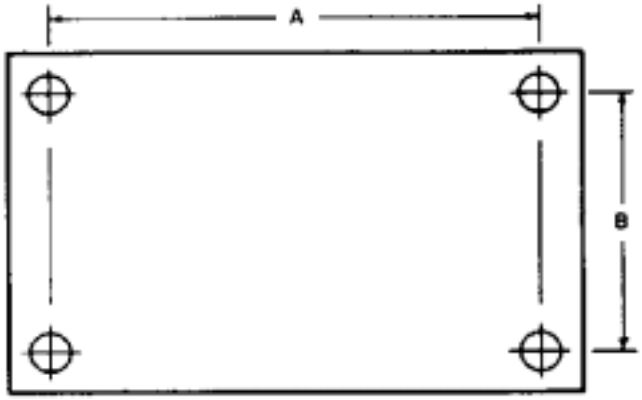

Rated Maximum Voltage (a) (kV, rms)	Dimensions			
	A		B	
	Inches	Centimeters	Inches	Centimeters
8.3	18	45.7	2 or 7	5 or 18
15.5 - 17.2	21	53.3	2 or 7	5 or 18
23.0 - 27.0	24 or 27	61 or 69	2 or 7	5 or 18
38.0	30 or 33	76 or 84	2, 3, or 7	5, 8 or 18
48.3	39	99	3 or 8-1/4	7.6 or 21
72.5	51	130	3 or 8-1/4	7.6 or 21
121.0	66	168	8-1/4	21
145.0	78	198	8-1/4	21
169.0	90	229	8-1/4	21

NOTES—(a) See clause 3.3.1.

Figure 1 – Preferred Base Mounting Dimensions

© Copyright 2001 by the National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale