ANSI C57.12.51 81 ■ 0724150 0004992 T ■

A-39-03

American National Standard

requirements for ventilated dry-type power transformers, 501 kVA and larger, three-phase, with high-voltage 601 to 34 500 volts, low-voltage 208Y/120 to 4160 volts

ANSI C57.12.51-1981

american national standards institute, inc.
1430 broadway, new york, new york 10018

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

ANSI®
C57.12.51-1981

American National Standard Requirements for Ventilated Dry-Type Power Transformers, 501 kVA and Larger, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts

Secretariat

Institute of Electrical and Electronics Engineers
National Electrical Manufacturers Association

Approved December 22, 1980

American National Standards Institute, Inc

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether he has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review and users are cautioned to obtain the latest editions.

CAUTION NOTICE: This American National Standard may be revised or withdrawn at any time. The procedures of the American National Standards Institute require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of publication. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute.

Published by

American National Standards Institute
1430 Broadway, New York, New York 10018

Copyright © 1981 by American National Standards Institute, Inc
All rights reserved.

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Printed in the United States of America

A1½M681/5

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

Foreword

(This Foreword is not a part of American National Standard Requirements for Ventilated Dry-Type Power Transformers, 501 kVA and Larger, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts, ANSI C57.12.51-1981.)

This new dry-type transformer standard describes ventilated dry-type transformers with self-cooled kilovolt-ampere ratings 501 to 7500 and high voltages 601 to 34 500 volts; forced-air-cooled ratings for certain sizes are listed in Part II. (American National Standards Committee on Specialty Transformers, C89, has responsibility for transformers with high voltages 600 volts and below.) This standard is part of a new series of dry-type standards that also includes American National Standard General Requirements for Dry-Type Distribution and Power Transformers, ANSI/IEEE C57.12.01-1979; American National Standard Test Code for Dry-Type Distribution and Power Transformers, ANSI/IEEE C57.12.91-1979; American National Standard Requirements for Ventilated Dry-Type Distribution Transformers, 1 to 500 kVA, Single-Phase, and 15 to 500 kVA, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 120 to 600 Volts, ANSI C57.12.50-1981; and American National Standard Requirements for Sealed Dry-Type Power Transformers, 501 kVA and Larger, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts, ANSI C57.12.52-1981.

Dry-type transformers have been served in the past by a variety of documents, including American National Standard General Requirements for Distribution, Power, and Regulating Transformers, ANSI C57.12.00-1973; American National Standard Test Code for Distribution, Power, and Regulating Transformers, ANSI C57.12.90-1973; American National Standard Dry-Type Transformers for General Applications, ANSI/NEMA ST 20-1972; and NEMA Standards Publication for Commercial, Institutional, and Industrial Dry-Type Transformers, NEMA TR 27-1965 (R1976). The new standards are the result of an effort encompassing the interests of users, manufacturers, and others dedicated to developing voluntary consensus standards primarily for dry-type transformers. They have various significant changes, including higher BILs (for most voltages), more stringent and meaningful short-circuit requirements, improved descriptions of "usual" and "unusual" service conditions, and numerous other improvements. These new standards should be easier and more efficient to use since they are arranged according to the sequence in which information is normally needed. ANSI C57.12.51-1981 includes customary units and metric (SI) units in accordance with ANSI policy. Sound levels were discussed in the preparation of this standard, but are not included at present. As a matter of information, NEMA TR 1-1980, Transformers, Regulators, and Reactors, includes data concerning dry-type transformer sound levels.

This standard is a voluntary consensus standard. Its use is mandatory only when required by a duly constituted legal authority or when specified in a contractual relationship. To meet specialized needs and to allow innovation, specific changes are permissible when mutually determined by the user and the producer, provided such changes do not violate existing laws and are considered technically adequate for the function intended.

When this document is used on a mandatory basis, the word "shall" indicates mandatory requirements, and the words "should" and "may" refer to matters which are recommended and permissive, respectively, but not mandatory.

The applicable ANSI rules and procedures for the preparation and approval of voluntary consensus standards have been followed. These specify procedures for voting, review and attempted reconciliation of dissenting viewpoints, a 60-day public review period, and a final review and approval by the ANSI Board of Standards Review.

Suggestions for improvement of this standard will be welcome. They should be sent to the American National Standards Institute, Inc, 1430 Broadway, New York, N.Y. 10018.

This standard was processed and approved for submittal to ANSI by American National Standards Committee on Transformers, Regulators, and Reactors, C57. Committee approval of the

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

standard does not necessarily imply that all committee members voted for its approval. At the time it approved this standard, the C57 Committee had the following members:

I. H. Koponen, Chairman
C. R. Willmore, Secretary

Organization Represented	*Name of Representative*
Bonneville Power Administration	G. W. Iliff
Electric Light and Power Group	R. R. Bast
	R. L. Ensign
	I. H. Koponen
	J. P. Markey (Alt)
	B. F. Smith
	E. A. Villasuso, Jr
Institute of Electrical and Electronics Engineers	S. Bennon
	J. C. Dutton
	D. C. Johnson
	L. W. Long
	D. E. Massey
	R. L. Simpson
National Electrical Manufacturers Association	L. C. Aicher
	W. R. Courtade
	J. W. Dix
	J. D. Douglass
	W. C. Kendall
	K. Lindsley (Alt)
	W. J. McNutt
	N. M. Neagle (Alt)
	R. L. Schwab
	R. J. Stahara (Alt)
	R. E. Uptegraff, Jr
Naval Facilities Engineering Command	H. P. Stickley
Rural Electrification Administration	J. C. Arnold, Jr
Tennessee Valley Authority	L. R. Smith
Underwriters Laboratories	W. A. Farquhar (Alt)
	E. J. Huber
U.S. Bureau of Reclamation	S. J. Baxter
U.S. Department of Energy	M. Smith, Jr

Subcommittee C57.12.5 on Dry-Type Transformers, which developed this standard, had the following members:

John C. Dutton, Chairman
Charles H. White, Secretary

B. F. Allen (Alt)
L. G. Ananian (Alt)
R. Bancroft
J. A. Berseth
D. R. Brown
F. J. Brutt
C. C. Dixon
R. Endicott
H. E. Gabel, Jr
R. H. Hollister (Alt)
P. Hopkinson
E. J. Huber
F. J. Klecic (Alt)
N. J. Melton
M. Mingoia (Alt)
J. J. Nay (Alt)
W. J. Neiswender
R. E. Rothrock
R. L. Simpson
S. G. Vargo
E. Villasuso, Jr
S. A. Wiencek

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Contents

SECTION PAGE

1. Scope . . . 7

2. Related Standards and Guides . . . 7
   2.1 General . . . 7
   2.2 Terminology . . . 8
   2.3 Revision of American National Standards Referred to in This Document . . . 8

Part I. Basic Electrical and Mechanical Requirements . . . 8

3. Usual Service Conditions . . . 8

4. Ratings and Characteristics . . . 8
   4.1 Kilovolt-Ampere Ratings . . . 8
   4.2 Kilovolt-Ampere and Voltage Ratings . . . 8
   4.3 Taps . . . 9
   4.4 Insulation Levels . . . 9
   4.5 Angular Displacement and Terminal Markings . . . 9
   4.6 Percent Impedance Voltage . . . 9

5. Construction . . . 10
   5.1 Insulation System . . . 10
   5.2 Accessory Location . . . 10
   5.3 Nameplate . . . 10
   5.4 Transformer Connections . . . 10
   5.5 Tap Changing . . . 10
   5.6 Lifting, Jacking, and Moving Facilities . . . 10
   5.7 Ground Pad . . . 11
   5.8 Transformer Enclosure . . . 11

6. Routine Tests . . . 11

7. Tolerances . . . 11

Part II. Other Requirements or Alternatives That May Be Specified for Some Applications . . . 12

8. Other Ratings and Characteristics . . . 12
   8.1 Forced-Air-Cooled Ratings . . . 12
   8.2 40°C Average Ambient Temperature Conditions . . . 12
   8.3 Other Winding Temperature Rises . . . 12
   8.4 Other Insulation Systems . . . 12
   8.5 Other High-Voltage Ratings and Connections . . . 12
   8.6 Y-Y Connected Transformers . . . 13
   8.7 Increased Neutral Insulation . . . 14
   8.8 Other Basic Lightning Impulse Insulation Levels (BILs) . . . 14

9. Other Construction . . . 14
   9.1 High-Voltage Connection Arrangements . . . 14
   9.2 Low-Voltage Connection Arrangements . . . 15
   9.3 Surge Arresters . . . 15
   9.4 Unit Substation Application . . . 15
   9.5 Temperature Devices . . . 15
   9.6 Forced-Air Cooling . . . 15
   9.7 Provision for Future Forced-Air-Cooling . . . 15
   9.8 Space Heaters . . . 15
   9.9 Current Transformers (or Provision for Their Addition in the Future) . . . 15
   9.10 Terminal Blocks . . . 15
   9.11 Contacts . . . 15

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

SECTION PAGE

10. Other Tests 15

Tables

Table 1 Range of Kilovolt-Ampere and Voltage Ratings for Three-Phase (AA) Transformers 8
Table 2 High-Voltage Line Terminal Insulation Levels 9
Table 3 Low-Voltage Line Terminal Insulation Levels 9
Table 4 Percent Impedance Voltage 9
Table 5 Clearance 11
Table 6 Self- and Forced-Air-Cooled Ratings 12
Table 7 Range of Other High-Voltage Ratings. 13
Table 8 Range of Kilovolt-Ampere and Voltage Ratings for Three-Phase (AA) Transformers Connected Y–Y 13
Table 9 High-Voltage Line Terminal Insulation Levels (Three-Phase, Y–Y Connected) . . 14
Table 10 Other Basic Lightning Impulse Insulation Levels (BILs) Applicable to Windings 14

Figures

Fig. 1 Angular Displacement. 9
Fig. 2 Accessory Location, Top (Plan) View 10
Fig. 3 Provision for Jacking 11
Fig. 4 Y–Δ Connection 13
Fig. 5 Y–Y Connection 14

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

American National Standard Requirements for Ventilated Dry-Type Power Transformers, 501 kVA and Larger, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts

1. Scope

1.1 This standard is intended to set forth characteristics relating to performance, limited electrical and mechanical interchangeability, and safety of the equipment described, and to assist in the proper selection of such equipment.

1.2 This standard describes certain electrical and mechanical characteristics and takes into consideration certain safety features of 60-Hz, two-winding, three-phase, ventilated dry-type transformers with self-cooled ratings 501 kVA and larger, generally used for step-down purposes. Forced-air-cooled ratings for certain sizes are listed in Part II.

Specific rating combinations are described in the range from 750/1000 to 7500/10 000 kVA inclusive, with high-voltage 2400 to 34 500 volts inclusive and low-voltage 208Y/120 to 4160 volts inclusive.

1.3 This standard does not apply to other types of transformers such as specialty, ventilated dry-type 500 kVA and smaller, sealed dry-type, pad-mounted dry-type, liquid immersed, instrument, regulating, furnace, mine, and rectifier transformers. Transformers with high voltage 600 volts or less are excluded.

1.4 When this standard is used on a mandatory basis, the word "shall" indicates mandatory requirements, and the words "should" and "may" refer to matters that are recommended and permissive, respectively, but not mandatory.

NOTE: The Foreword of this standard describes the circumstances under which the document may be used on a mandatory basis.

1.5 Part I of this standard describes electrical and mechanical requirements. Part II describes other requirements or alternatives which may be specified for some applications.

2. Related Standards and Guides

2.1 General. All requirements, definitions, and tests, except as specifically covered in this standard, shall be in accordance with the American National Standards listed below (see 2.3). When referred to in this document, standards are identified by designation and year (for example, ANSI/IEEE C57.12.01-1979).

American National Standard for Unified Inch Screw Threads (UN and UNR Thread Forms), ANSI B1.1-1974

American National Standard Requirements for Ventilated Dry-Type Distribution Transformers, 1 to 500 kVA, Single-Phase, and 15 to 500 kVA, Three-Phase; with High-Voltage 601 to 34 500 Volts, Low-Voltage 120 to 600 Volts, ANSI C57.12.50-1981

American National Standard Requirements for Sealed Dry-Type Power Transformers, 501 kVA and Larger, Three-Phase; with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts, ANSI C57.12.52-1981

American National Standard Terminal Markings and Connections for Distribution and Power Transformers, ANSI C57.12.70-1978

American National Standard Guide for Installation and Maintenance of Dry-Type Transformers, ANSI Appendix C57.94 (1958)

American National Standard Guide for Application of Valve-Type Lightning Arresters for Alternating-Current Systems, ANSI C62.2-1980

American National Standard Voltage Ratings for Electric Power Systems and Equipment (60 Hz), ANSI C84.1-1977 and C84.1a-1980

American National Standard General Requirements for Dry-Type Distribution and Power Transformers, ANSI/IEEE C57.12.01-1979

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

American National Standard Terminology for Distribution and Power Transformers, ANSI/IEEE C57.12.80-1978

American National Standard Test Code for Dry-Type Distribution and Power Transformers, ANSI/IEEE C57.12.91-1979

American National Standard Requirements for Instrument Transformers, ANSI/IEEE C57.13-1978

American National Standard Guide for Application of Transformer Connections in Three-Phase Distribution Systems, ANSI/IEEE C57.105-1978

American National Standard Dictionary of Electrical and Electronics Terms, ANSI/IEEE 100-1977

2.2 Terminology. Transformer terminology as set forth in ANSI/IEEE C57.12.80-1978 shall apply. Other electrical terms are defined in ANSI/IEEE 100-1977.

2.3 Revision of American National Standards Referred to in This Document. When an American National Standard referred to in this document is superseded by a revision approved by the American National Standards Institute, Inc, the revision shall apply.

Part I: Basic Electrical and Mechanical Requirements

(See Part II for other requirements or alternatives that may be specified for some applications.)

3. Usual Service Conditions

Service conditions shall be in accordance with those described in ANSI/IEEE C57.12.01-1979.

4. Ratings and Characteristics

4.1 Kilovolt-Ampere Ratings

4.1.1 Kilovolt-ampere ratings are continuous and based on not exceeding a 150°C average winding temperature rise, as measured by resistance (220°C limiting temperature).

4.1.2 Self-cooled (AA) kilovolt-ampere sizes shall be 750, 1000, 1500, 2000, 2500, 3750, 5000, and 7500 kVA.

4.2 Kilvolt-Ampere and Voltage Ratings. Kilovolt-ampere and voltage ratings for three-phase self-cooled (AA) transformers shall be as shown in Table 1.

NOTE: At voltages 15 kV and above, Y–Y design transformers (described in Part II of this standard) may be required by utility users because of special system requirements.

Table 1
Range of Kilovolt-Ampere and Voltage Ratings for Three-Phase (AA) Transformers

	Kilovolt-Ampere Ratings (kVA)		
Rated High Voltage (volts)	Low Voltage 208Y/120	Low Voltages 480, 480Y/277	Low Voltages 2400, 4160GrdY/2400, 4160
2 400	750–1000	750–1500	–
4 160	750–1000	750–1500	–
4 800	750–1000	750–1500	–
6 900	750–1000	750–2500	–
7 200	750–1000	750–2500	–
12 000	750–1000	750–2500	750–7500
13 200	750–1000	750–2500	750–7500
13 800	750–1000	750–2500	750–7500
23 000	750–1000	1000–2500	1500–7500
34 500	750–1000	1000–2500	1500–7500

NOTES:
(1) All voltages are Δ unless otherwise indicated.
(2) Kilovolt-ampere ratings separated by a dash indicate that all the intervening ratings listed in 4.1.2 are included.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

4.3 Taps. Four high-voltage winding rated kilovolt-ampere taps shall be provided as follows: two 2.5% taps above rated voltage, and two 2.5% taps below rated voltage.

4.4 Insulation Levels. High-voltage line terminal insulation levels shall be as shown in Table 2. Low-voltage line terminal insulation levels shall be as shown in Table 3.

4.5 Angular Displacement and Terminal Markings

4.5.1 Angular Displacement. The angular displacement between high-voltage and low-voltage terminal voltages of three-phase transformers with Δ–Δ connections shall be 0 degrees. The angular displacement between high-voltage and low-voltage terminal voltages of three-phase transformers with Δ–Y connections shall be 30 degrees, with the low voltage lagging the high voltage as shown in Fig. 1; phasor relations shall be as shown in Fig. 1.

4.5.2 External Terminal Designations. Terminal designations shall be in accordance with ANSI C57.12.70-1978.

4.6 Percent Impedance Voltage. The preferred percent impedance voltage at the self-cooled rating as measured on the rated voltage connection shall be as shown in Table 4.

Table 2
High-Voltage Line Terminal Insulation Levels


Rated High Voltage (volts)	Basic Lightning Impulse Insulation Level (BIL) (kV)	Low-Frequency Voltage Insulation Level (kV, rms)
2 400	20	10
4 160	30	12
4 800	30	12
6 900	30	12
7 200	30	12
12 000	60	31
13 200	60	31
13 800	60	31
23 000	110	37
34 500	150	50

NOTE: All voltages are Δ unless otherwise indicated.


Table 3
Low-Voltage Line Terminal Insulation Levels

Rated Low Voltage (volts)	Basic Lightning Impulse Insulation Level (BIL) (kV)	Low-Frequency Voltage Insulation Level (kV, rms)
208Y/120	10	4
480	10	4
480Y/277	10	4
2400	20	10
4160GrdY/2400	20	10
4160	30	12

NOTES:
(1) All voltages are Δ unless otherwise indicated.
(2) Neutrals are insulated for low-frequency applied voltage test equal to that of the winding line terminal or 10 kV, whichever is lower.

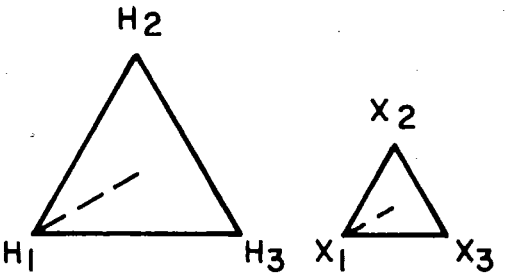

Δ–Δ Connection
(a)

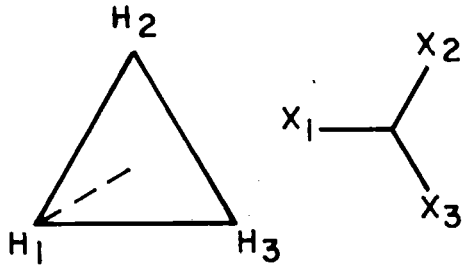

Δ–Y Connection
(b)

Fig. 1
Angular Displacement

Table 4
Percent Impedance Voltage

High Voltage BIL (kV)	Low Voltage	
	600 Volts and Below	2400 Volts and Above
60 and below	5.75	5.75
Above 60	See Note	See Note

NOTE: In view of the relatively little experience industry has had in building and applying dry-type transformers above 15 kV high voltage, no consensus regarding standard values of impedance has yet been established. Such impedances should be determined by discussion between users and manufacturers until experience is available to determine consensus values.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

5. Construction (See Fig. 2)

5.1 Insulation System. The insulation system of the transformer shall be suitable for operation at the limiting temperature associated with the kilovolt-ampere rating (see Section 4 or 8, as appropriate).

5.2 Accessory Location. Preferred locations of accessories, connections, compartments, and the like, are given in Fig. 2 and its referenced paragraphs.

5.3 Nameplate. A nameplate shall be provided in accordance with the requirements of ANSI/IEEE C57.12.01-1979 and shall be located on the front wall in segment 1.

5.4 Transformer Connections

5.4.1 High-Voltage Line Connections. High-voltage line connections shall be located on the side wall in segment 2.

5.4.2 Low-Voltage Line Connections. Low-voltage line connections shall be located on the side wall in segment 4.

5.4.3 Neutral Connections. The neutral shall be either a blade connected directly to the housing or frame or a terminal insulated for the appropriate low-frequency voltage insulation level shown in Table 3.

When the neutral terminal is connected directly to the housing or frame, provision shall be made for disconnecting the winding neutral.

When a grounded-Y winding is involved, the connection from the neutral terminal to ground shall be furnished by the manufacturer as a part of the associated equipment, such as switchgear or terminal compartments. (See 9.1.3, 9.1.4, 9.1.5, 9.2.3, 9.2.4, and 9.2.5.)


5.5 Tap Changing. Facilities shall be furnished for changing taps with the transformer de-energized and shall be either physically marked or described on the nameplate.

5.6 Lifting, Jacking, and Moving Facilities

5.6.1 Safety Factor. Lifting, jacking, and moving facilities shall be designed to provide a safety factor of five, or more. The safety factor is the ratio of the ultimate stress of the material used to the working stress. The working stress is the maximum combined stress developed in the lifting, jacking, or moving facilities by the static load of the component being lifted or moved.

5.6.2 Lifting Facilities. A minimum of two lifting points shall be provided for lifting the core and coil assembly separately, using one lifting cable at each lifting point.

Lifting facilities shall be provided for lifting the complete transformer. Lifting facilities shall be designed for lifting using one lifting cable at each lifting point, and with a maximum cable angle of 30 degrees with respect to the vertical. Lifting points shall provide a balanced lift to prevent overturning. The bearing surfaces of lifting facilities shall be free from sharp edges and shall be provided with a hole having a minimum diameter of 2.0 inches (51 mm) for guying purposes.

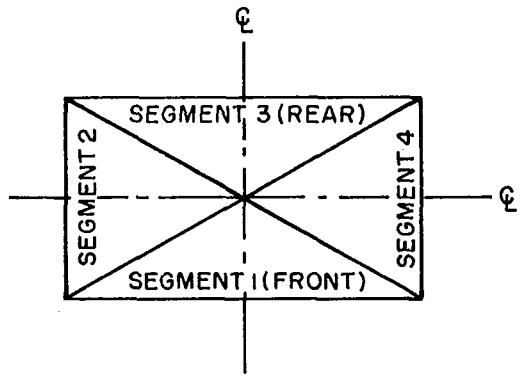

Item	Paragraph Reference
Nameplate	5.3
High-voltage connections	5.4.1
Low-voltage connections	5.4.2
Tap-changing facilities	5.5
Jacking facilities	5.6.3
Ground pad	5.7
Temperature devices*	9.5
Terminal block*	9.10

*When specified; see Part II.

Fig. 2
Accessory Location
Top (Plan) View


NOTES:
(1) Depending on the design and the manufacturer's instructions, it may be necessary to have the cover in place when lifting, or it may be necessary to remove the cover to engage the lifting cables with the lifting facilities.
(2) A spreader bar may be required to prevent enclosure damage if lifting from the base or side structure, as specified in the manufacturer's instructions.

5.6.3 Jacking Facilities. Jacking facilities shall be provided in the vicinity of the four corners of the base. For transformers rated above 2500 kVA, jacking clearances shall be in accordance with Fig. 3.

5.6.4 Base Structure. The base structure shall be designed for moving the transformer by rolling or skidding in either direction parallel to the centerlines of the transformer.

5.6.5 Tilting. The points of support shall be so located that the center of gravity of the transformer as prepared for shipment will not fall outside these points

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

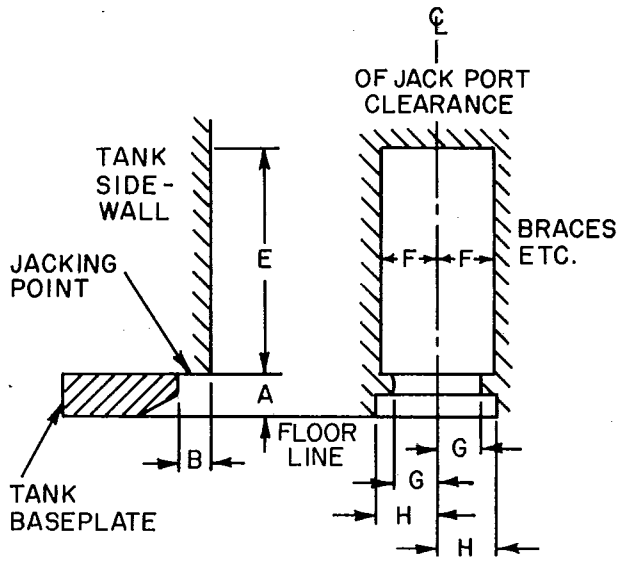

	Weight			
	35 000 lb (15 900 kg) or Less		35 000 to 65 000 lb (15 900 to 29 500 kg)	
Dimension	Inches	Millimeters	Inches	Millimeters
A	3-1/2	88.9	5	127
B	2-1/2	63.5	2-1/2	63.5
E	27	686	27	686
F	5	127	5	127
G	3	76.2	3	76.2
H	5	127	5	127

NOTES:
(1) Dimensions E, F, G, and H are free clearances.
(2) Where manufacturers' standard designs require, any dimension may be in excess of those shown.
(3) E applies to nonremovable braces, boxes, and the like.

Fig. 3
Provision for Jacking
(Transformers above 2500 kVA)

of support for a tilt of the base of 15 degrees or less from the horizontal.

5.7 Ground Pad. Grounding provision shall consist of a pad with a corrosion-resistant metallic surface, 2 inches X 3-1/2 inches (50.8 mm X 88.9 mm), with two holes horizontally spaced on 1-3/4-inch (44.5-mm) centers drilled and tapped for a 1/2-inch-13-NC thread, in accordance with ANSI B1.1-1974, and having a minimum thread depth of 1/2 inch (12.7 mm). The ground pad shall be welded to the base structure or housing and shall be located at the end of the transformer in segment 4.

Table 5
Clearance

	Clearance	
kV Class	Inches	Millimeters
1.2	4	102
2.5	5	127
5	5.5	140
8.7	6.5	165
15	8	203
25	11	279
34.5	15	381

5.8 Transformer Enclosure. The enclosure shall be noncombustible, moisture resistant, protected against corrosion, and self-supporting, and all enclosure parts shall be fastened to other enclosure parts. Panels of two sides shall be removable to permit inspection, cleaning, maintenance, and maintenance testing of the core and coil assembly.

A ventilating opening in an enclosure shall prevent the insertion of a straight rod having a diameter of 0.500 inch (12.7 mm), except that if the distance between the opening and the nearest not fully insulated live part is greater than indicated in Table 5, the opening may permit the entry of a rod having a diameter greater than 0.500 inch (12.7 mm), but not greater than 0.750 inch (19.0 mm). A barrier may be placed between an opening and live parts to comply with this requirement. If used, a barrier shall be so located that it intercepts all live parts from line of sight through the opening protected.

Exception: An opening above the upper edge of the enclosure side wall, but under the overhang of the top, is acceptable if by means of its size, barrier, and the like, it will prevent a straight rod 0.500 inch (12.7 mm) in diameter from approaching any insulated live part inside the enclosure by a distance not less than the clearance indicated in Table 5.

6. Routine Tests

Routine tests shall be made in accordance with ANSI/IEEE C57.12.01-1979.

7. Tolerances

Tolerances on ratio, impedance, and losses shall be in accordance with ANSI/IEEE C57.12.01-1979.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Part II: Other Requirements or Alternatives That May Be Specified for Some Applications

(See Part I for basic electrical and mechanical requirements.)

NOTE: Certain specific applications have transformer requirements not covered in Part I. Part II comprises descriptions of the most frequently used requirements for such transformers. They shall be provided only when specified in conjunction with Part I requirements or, where applicable, as alternatives to Part I requirements.

8. Other Ratings and Characteristics

8.1 Forced-Air-Cooled Ratings. When specified, forced-air-cooled (AA/FA) kilovolt-ampere ratings for three-phase transformers shall be as shown in Table 6.

Kilovolt-ampere ratings are continuous and based on not exceeding the specified winding temperature rise limits described in 4.1, 8.2, or 8.3.

8.2 40°C Average Ambient Temperature Conditions. When specified, the transformer shall be designed for operation in a location in which the maximum temperature of the cooling air (ambient temperature) does not exceed 50°C at any time and the average temperature of the cooling air for any 24-hour period does not exceed 40°C.

When this increased ambient temperature is specified, the kilovolt-ampere continuous rating of 4.1 shall be based on not exceeding a 140°C average winding temperature rise, as measured by resistance (220°C limiting temperature).

8.3 Other Winding Temperature Rises

8.3.1 When specified, the kilovolt-ampere continuous rating shall be based on not exceeding an 80°C average winding temperature rise, as measured by resistance (150°C limiting temperature).

Table 6
Self- and Forced-Air-Cooled Ratings

Self-Cooled (AA) Ratings (kVA)	Forced-Air-Cooled (AA/FA) Ratings (kVA)
750	1000
1000	1333
1500	2000
2000	2667
2500	3333
3750	5000
5000	6667
7500	10000

When increased ambient temperature is specified in accordance with 8.2, this kilovolt-ampere continuous rating shall be based on not exceeding a 70°C average winding temperature rise, as measured by resistance (150°C limiting temperature).

8.3.2 When specified, the kilovolt-ampere continuous rating shall be based on not exceeding a 115°C average winding temperature rise, as measured by resistance (185°C limiting temperature).

When increased ambient temperature is specified in accordance with 8.2, this kilovolt-ampere continuous rating shall be based on not exceeding a 105°C average winding temperature rise, as measured by resistance (185°C limiting temperature).

8.4 Other Insulation Systems

8.4.1 When specified, transformers designed for an 80°C average winding temperature rise, as measured by resistance, shall be provided with a 150°C-rise insulation system (220°C limiting temperature) as defined in 5.11.3 of ANSI/IEEE C57.12.01-1979.

8.4.2 When specified, transformers designed for a 115°C average winding temperature rise, as measured by resistance, shall be provided with a 150°C-rise insulation system (220°C limiting temperature) as defined in 5.11.3 of ANSI/IEEE C57.12.01-1979.

8.5 Other High-Voltage Ratings and Connections

8.5.1 High-Voltage Windings without Taps. When specified, the high-voltage winding shall be furnished without taps.

8.5.2 Other High-Voltage Ratings. When specified, high-voltage ratings may be selected within the range of ratings listed in Table 7. These are rated high voltages (line-to-line) and are alternates to the high-voltage ratings listed in Tables 1 and 2.

The rated voltage should be the midtap voltage, and all performance characteristics shall be based on the rated voltage.

Four rated kilovolt-ampere equally spaced voltage taps, two above rated voltage and two below rated voltage, should be provided for high voltages selected from Table 7. The total tap voltage range should not exceed 10%.

The percent tap voltage range shall be calculated as follows:

$$\text{Percent tap range} = \frac{(\text{maximum tap voltage} - \text{minimum tap voltage})100}{\text{rated tap voltage}}$$

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 7
Range of Other High-Voltage Ratings

Basic Lightning Impulse Insulation Level (BIL) (kV)	Range of Other Voltage Ratings (Line-to-Line) (volts)
20	2 160–2 500
30	2 501–7 200
45	7 201–8 320
60	8 321–13 800
95	13 801–18 000*
110	18 001*–23 000
125	23 001–27 600*
150	27 601*–34 500

*Nonpreferred voltage, as listed in ANSI C84.1-1977 and ANSI C84.1a-1980.

NOTES:
(1) All voltages are Δ.
(2) Voltages separated by a dash indicate that all intervening voltages are included.
(3) It is suggested that when voltages higher than those listed in ANSI/IEEE C57.12.01-1979, Table 3, or grounded-Y voltages are involved, the surge protection be reviewed (in accordance with ANSI/IEEE C57.12.01-1979, Table 3, and ANSI C62.2-1980) and appropriate changes made in BIL, if necessary.

8.5.3 Y-Connected High-Voltage Windings with Δ-Connected Low-Voltage Windings

NOTE: See ANSI/IEEE C57.105-1978 for problems that may result if the high-voltage neutral is grounded with the high-voltage Y-connected and the low-voltage Δ-connected. (For Y–Y connected transformers, see 8.6).

8.5.3.1 When specified, three-phase transformers with high voltage rated in accordance with Table 7 shall be furnished. The neutral insulation shall be in accordance with ANSI/IEEE C57.12.01-1979.

8.5.3.2 The angular displacement between high-voltage and low-voltage terminal voltages of Y–Δ connected three-phase transformers shall be 30 degrees, and the phasor relation shall be as shown in Fig. 4.

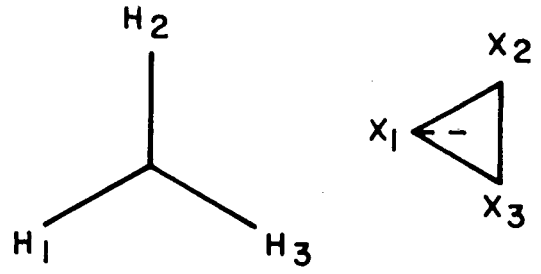


Fig. 4
Y–Δ Connection

8.6 Y–Y Connected Transformers

8.6.1 Kilovolt-Ampere, Voltage, and BIL Combinations. When specified, Y–Y connected transformers shall be furnished with the kilovolt-ampere and voltage combinations described in Table 8. Basic lightning impulse insulation levels shall be furnished as described in Tables 9 and 3.

NOTE: ANSI/IEEE C57.105-1978 includes extensive discussion of Y–Y connection characteristics.

8.6.2 Unsymmetrical Excitation or Loading. Unsymmetrical excitation or loading of Y–Y connected units may cause heating of their enclosures in excess of that which would be produced by balanced conditions. To reduce the probability of this enclosure heating, such units shall be provided, when specified, with a construction that will not cause magnetic core saturation when 33% zero-sequence voltage is applied.

8.6.3 Angular Displacement of Y–Y Connected Transformers. The angular displacement between high-

Table 8
Range of Kilovolt-Ampere and Voltage Ratings for Three-Phase (AA) Transformers Connected Y–Y

Rated High Voltage (volts)	Kilovolt-Ampere Ratings (kVA)		
	Low Voltage 208Y/120	Low Voltage 480Y/277	Low Voltage 4160GrdY/2400
4 160GrdY/2 400	750–1000	750–1500	–
12 000GrdY/6 930	750–1000	750–2500	750–7500
12 470GrdY/7 200	750–1000	750–2500	750–7500
13 200GrdY/7 620	750–1000	750–2500	750–7500
13 800GrdY/7 970	750–1000	750–2500	750–7500
22 860GrdY/13 200	750–1000	1000–2500	1500–7500
24 940GrdY/14 400	750–1000	1000–2500	1500–7500
34 500GrdY/19 920	750–1000	1000–2500	1500–7500

NOTE: Kilovolt-ampere ratings separated by a dash indicate that all the intervening ratings listed in 4.1.2 are included.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 9
High-Voltage Line Terminal Insulation Levels
(Three-Phase, Y–Y Connected)

Rated High Voltage (volts) (Note 1)	Basic Lightning Impulse Insulation Level (BIL) (kV)	Low-Frequency Voltage Insulation Level (kV, rms) (Notes 1, 2)
4 160GrdY/2 400	20	10
12 000GrdY/6 930	60	10
12 470GrdY/7 200	60	10
13 200GrdY/7 620	60	10
13 800GrdY/7 920	60	10
22 860GrdY/13 200	95	10
24 940GrdY/14 400	110	10
34 500GrdY/19 920	125	10

NOTES:
(1) Neutrals are insulated for low-frequency applied voltage test equal to that of winding line terminal or 10 kV, whichever is lower.
(2) Windings shall be capable of withstanding an induced voltage test of two times rated voltage (with neutral grounded) from line terminals to ground and between line terminals, in accordance with ANSI/IEEE C57.12.91-1979.

voltage and low-voltage terminal voltages of three-phase transformers with Y–Y connections shall be 0 degrees, and the phasor relation shall be as shown in Fig. 5.

8.6.4 Neutral Connections. For Y–Y connected units, the high-voltage neutral shall be connected to the low-voltage neutral internally, with provision for opening this connection for testing, or the high-voltage neutral shall be brought out through a separate lead or bushing and grounded externally.

8.7 Increased Neutral Insulation. When specified, increased neutral insulation shall be provided for ratings that normally have reduced neutral insulation, but shall not exceed the insulation level of the line terminals of the winding involved.

8.8 Other Basic Lightning Impulse Insulation Levels (BILs). When specified, other basic impulse insulation levels shall be provided in accordance with Table 10.

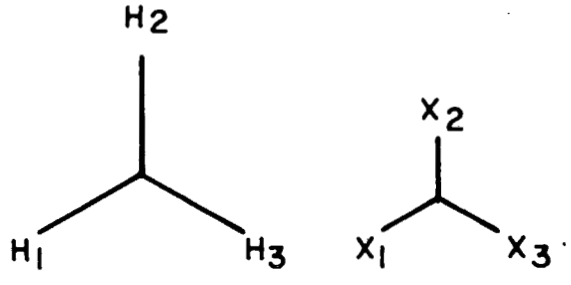


Fig. 5
Y–Y Connection

Table 10
Other Basic Lightning Impulse Insulation Levels (BILs) Applicable to Windings

BIL* (kV)	Other BIL (kV)
20	30, 45
30	45, 60
45	60, 95
60	95, 110
95	110, 125
110	125, 150
125	150

*BILs corresponding to rated voltages listed in Tables 2, 3, 5, or 7 of this publication, or in Table 3 of ANSI/IEEE C57.12.01-1979.

9. Other Construction (See Fig. 2)

9.1 High-Voltage Connection Arrangements

9.1.1 When specified, high-voltage terminals or leads shall be located in segment 3.

9.1.2 When specified, high-voltage terminals shall be provided on the cover in segment 3, or at the top of the end walls in segments 2 or 4.

9.1.3 When an air-filled terminal compartment is specified, it shall be located adjacent to segment 2 or 4. When the transformer high voltage is connected grounded Y, a removable ground strap shall be provided between the neutral terminal and a ground pad.

9.1.4 When a flange for connection to switchgear is specified, it shall be located adjacent to segment 2 or 4.

9.1.5 When a fused or unfused air interrupter

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

switch or a current-limiting fuse is specified, it shall be located adjacent to segment 2 or 4.

9.1.6 When specified, provision shall be made in segment 1 or 3 for connection to cables.

NOTE: Design limitations may preclude placing both high-voltage and low-voltage cables together in a single segment.

9.1.7 When specified, a second ground pad as described in 5.7 shall be provided and located in the same segment as the high-voltage compartment.

9.2 Low-Voltage Connection Arrangements

9.2.1 When specified, low-voltage terminals or leads shall be located in segment 1.

9.2.2 When specified, low-voltage terminals shall be located on the cover in segment 1, or at the top of the end walls in segments 2 or 4.

9.2.3 When an air-filled terminal compartment is specified, it shall be located adjacent to segment 2 or 4. When the transformer low voltage is connected grounded Y, a removable ground strap shall be provided between the neutral terminal and a ground pad.

9.2.4 When a flange for connection to switchgear is specified, it shall be located adjacent to segment 2 or 4.

9.2.5 When a circuit-breaker panel is specified, it shall be located adjacent to segment 2 or 4.

9.3 Surge Arresters. When high-voltage or low-voltage surge arresters are specified, they shall be provided with connections to ground.

9.4 Unit Substation Application. When specified for application as part of a unit substation, the arrangement of terminals, accessories, and the like, for "standard" and "reverse" units (or "right-" and "left-hand") shall be as described in ANSI C57.12.70-1978.

The tap changing facilities of a "reverse" unit may be located on the opposite side of the transformer as compared to the location on a "standard" unit.

9.5 Temperature Devices

9.5.1 Winding Temperature Simulator or Hot-Spot Device. When specified, a winding temperature simulator or hot-spot device shall be furnished.

9.5.2 Adjustable Contacts. When specified, adjustable contacts shall be provided.

9.5.2.1 When specified, a contact for control of fans shall be included and shall (unless otherwise specified) be set to close when the winding temperature is not less than 10°C below the rated average winding temperature rise, plus maximum ambient.

9.5.2.2 When specified, an alarm contact shall be included and shall (unless otherwise specified) be set to close when the winding temperature is not more than 5°C higher than the rated average winding temperature rise, plus maximum ambient.

9.5.2.3 When specified, other fan control and alarm contact settings shall be furnished. The range for alternate contact settings shall be within ±15°C of the sum of the rated average winding temperature rise and the maximum ambient temperature.

9.6 Forced-Air Cooling. When specified, fans and equipment for automatic control of fans from a winding temperature simulator or hot-spot device shall be furnished.

The preferred voltages for fan motors shall be 230 or 120 volts single phase. Fan motors shall be furnished without a centrifugal switch. Fans and their circuits shall be protected by an overcurrent device, furnished by the user.

9.7 Provision for Future Forced-Air Cooling. When specified, class-AA transformers shall be designed with provision for the future addition of fans to obtain the kilovolt-ampere ratings of 8.1 and shall include a temperature device for control of fans.

9.8 Space Heaters. When specified, manually switched space heaters shall be provided.

9.9 Current Transformers (or Provision for Their Addition in the Future). When specified, current transformers shall be provided and shall be in accordance with ANSI/IEEE C57.13-1978. There shall be a maximum of two per line.

Two secondary leads per current transformer shall be brought to a terminal block. Provision for short circuiting shall be supplied.

9.9.1 When specified, single-ratio current transformers with relay accuracy class shall be provided.

9.9.2 When specified, current transformers shall be multiratio with relay accuracy class (full winding) and taps as specified by ANSI/IEEE C57.13-1978.

9.10 Terminal Blocks. When specified, enclosed terminal blocks shall be provided and located in segment 1 or in the low-voltage segment.

9.10.1 A terminal block shall be provided for alarm circuits.

9.10.2 A terminal block shall be provided for current transformer secondaries, allowing for two leads per current transformer.

9.11 Contacts. Nongrounded contacts for instruments and alarms shall be suitable for interrupting:

(1) 0.02-ampere direct-current inductive load;

(2) 0.20-ampere direct-current noninductive load;

(3) 2.5-ampere alternating-current load (either noninductive or inductive);

(4) 250 volts minimum in all cases.

10. Other Tests

When specified, other tests shall be made in accordance with ANSI/IEEE C57.12.01-1979.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

American National Standards in the C57 Series

ANSI/IEEE C57.12.00-1980 General Requirements for Liquid-Immersed Distribution, Power, and Regulating Transformers (see Appendix C57.91)

ANSI/IEEE C57.12.01-1979 Requirements for Dry-Type Distribution and Power Transformers

ANSI C57.12.10-1977 Requirements for Transformers 230 000 Volts and Below, 833/958 through 8333/10 417 kVA Single-Phase and 750/862 through 60 000/80 000/100 000 kVA Three-Phase, including Supplement ANSI C57.12.10a-1978

ANSI/IEEE C57.12.11-1980 Guide for Installation of Oil-Immersed Transformers, 10 000 kVA and Larger, and 69 kV to 287 kV Voltage Rating

ANSI/IEEE C57.12.12-1980 Guide for Installation of Oil-Immersed EHV Transformers 345 kV and Above

ANSI C57.12.20-1981 Requirements for Overhead-Type Distribution Transformers 67 000 Volts and Below; 500 kVA and Smaller

ANSI C57.12.21-1980 Requirements for Pad-Mounted, Compartmental-Type, Self-Cooled, Single-Phase Distribution Transformers with High-Voltage Bushings: High-Voltage, 34 500 GrdY/19 920 Volts and Below; Low-Voltage, 240/120 Volts; 167 kVA and Smaller

ANSI C57.12.22-1980 Requirements for Pad-Mounted, Compartmental-Type, Self-Cooled, Three-Phase Distribution Transformers with High-Voltage Bushings: High-Voltage, 34 500 GrdY/19 920 Volts and Below; 2500 kVA and Smaller

ANSI C57.12.23-1978 Requirements for Underground-Type Single-Phase Distribution Transformers with Separable Insulated High-Voltage Connectors, 100 kVA and Smaller: High-Voltage, 24 940 GrdY/14 400 Volts and Below; Low-Voltage 240/120

ANSI C57.12.24-1978 Requirements for Underground-Type Three-Phase Distribution Transformers; 2500 kVA and Smaller; High-Voltage, 24 940 GrdY/14 400 Volts and Below; Low-Voltage, 480 Volts and Below

ANSI C57.12.25-1981 Requirements for Pad-Mounted Compartmental-Type Self-Cooled Single-Phase Distribution Transformers with Separable Insulated High-Voltage Connectors: High-Voltage, 34 500, GrdY/19 920 Volts and Below: Low-Voltage, 240/120 Volts and Below; 167 kVA and Smaller

ANSI C57.12.26-1975 Requirements for Pad-Mounted Compartmental-Type, Self-Cooled, Three-Phase Distribution Transformers for Use with Separable Insulated High-Voltage Connectors: High-Voltage, 24 940GrdY/14 400 Volts and Below; 2500 kVA and Smaller

ANSI C57.12.30-1977 Requirements for Load-Tap-Changing Transformers 230 000 Volts and Below, 3750/4687 through 60 000/80 000/100 000 kVA, Three Phase

ANSI C57.12.40-1975 Requirements for Secondary Network Transformers, Subway and Vault Types (Liquid Immersed)

ANSI C57.12.50-1981 Requirements for Ventilated Dry-Type Distribution Transformers, 1 to 500 kVA Single-Phase and 15 to 500 kVA Three-Phase, with High-Voltage 601-34 500 Volts, Low-Voltage 120-600 Volts

ANSI C57.12.51-1981 Requirements for Ventilated Dry-Type Power Transformers, 501 kVA and Larger Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts

ANSI C57.12.52-1981 Requirements for Sealed Dry-Type Power Transformers 501 kVA and Larger, Three-Phase, with High-Voltage 601 to 34 500 Volts, Low-Voltage 208Y/120 to 4160 Volts

ANSI C57.12.70-1978 Terminal Markings and Connections for Distribution and Power Transformers

ANSI/IEEE C57.12.80-1978 Terminology for Power and Distribution Transformers

ANSI/IEEE C57.12.90-1980 Test Code for Liquid-Immersed Distribution, Power, and Regulating Transformers

ANSI/IEEE C57.12.91-1979 Test Code for Dry-Type Distribution and Power Transformers

ANSI/IEEE C57.13-1978 Requirements for Instrument Transformers

ANSI C57.15-1968 Requirements, Terminology, and Test Code for Step-Voltage and Induction-Voltage Regulators

ANSI C57.16-1958 (R1971) Requirements, Terminology, and Test Code for Current-Limiting Reactors

ANSI C57.17-1965 (R1978) Requirements for Arc Furnace Transformers

ANSI C57.21-1971 Requirements, Terminology, and Test Code for Shunt Reactors

ANSI/IEEE C57.100-1974 Test Procedure for Thermal Evaluation of Oil-Immersed Distribution Transformers

ANSI/IEEE C57.104-1978 Guide for the Detection and Determination of Generated Gases in Oil-Immersed Transformers and their Relation to the Serviceability of the Equipment

ANSI/IEEE C57.105-1978 Guide for Application of Transformer Connections in Three-Phase Distribution Systems

ANSI/IEEE C57.106-1977 Guide for Acceptance and Maintenance of Insulating Oil in Equipment

Appendixes to C57 Standards

(Not approved as American National Standards)

C57.91 Guide for Loading Mineral Oil-Immersed Overhead-Type Distribution Transformers with 55°C or 65°C Average Winding Rise, Appendix to C57.12.00-1973 (IEEE Std 462-1973)

C57.92 Guide for Loading Oil-Immersed Distribution and Power Transformers, Appendix to C57.12 standards

C57.94 Guide for Installation and Maintenance of Dry-Type Transformers, Appendix to C57.12 standards

C57.95 Guide for Loading Oil-Immersed Step-Voltage and Induction-Voltage Regulators, Appendix to C57.15-1968

C57.96 Guide for Loading Dry-Type Distribution and Power Transformers, Appendix to C57.12 standards

C57.97 Guide for Preparation of Specifications for Large Power Transformers, With or Without Load-Tap-Changing, Appendix to C57.12 standards

C57.99 Guide for Loading Dry-Type and Oil-Immersed Current-Limiting Reactors, Appendix to C57.16-1958 (R1971)

American National Standards Institute, Inc
1430 Broadway New York, N.Y. 10018

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale