TC 10-83 6470247 0004200 7 A-07-07

STANDARDS PUBLICATION / NO. TC 10-1983

nema

PVC and ABS Plastic Communications Duct and Fittings for Underground Installation

NEMA

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION ■ 2101 L STREET, N.W., WASHINGTON, D.C. 20037

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

TABLE OF CONTENTS

		Page
	FOREWORD	i
	SCOPE	i
Section 1	REFERENCED STANDARDS	1
Section 2	GENERAL	
	Definitions and Abbreviations	2
	Materials	2
	Nominal Sizes	2
	Dimensions	2
	Workmanship	4
	Inspection	4
Section 3	REQUIREMENTS AND TEST METHODS	
	Conditioning Test Specimens and Test Conditions	14
	Joint Tightness (Referee Test Only)	14
	Extrusion Quality	14
	Hydrocarbon Resistance	14
	Duct Impact Resistance	14
	Duct Stiffness	14
	Marking	15
Appendix A	SOCKET BOTTOM AND SOCKET ENTRANCE GO NO-GO GAGE FOR BELLED END DIMENSIONS SHOWN IN TABLE 2-2	
	Socket Bottom Go No-Go Gage	16
	Socket Entrance Go No-Go Gage	16
Appendix B	INSTALLATION PRACTICES	17

© 1984 by National Electrical Manufacturers Association

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Foreword

The purpose of this Standards Publication for plastic communications duct for underground installation is: to list dimensions and other significant requirements, and to set forth some of the properties of this product as well as to assist in selecting and obtaining the proper product for a particular need.

User needs have been considered throughout the development of these standards. Test methods and performance values have been related as closely as possible to end-use applications.

The Plastic Conduit, Duct and Accessories Section of NEMA, through its members, has worked (and continues to work) closely with such organizations as the American Society for Testing and Materials, the Plastic Pipe Institute, the Western Underground Committee, appropriate government agencies, and others in the periodic review and revision of these standards for any changes necessary to keep them up to date with advancing technology. Proposed or recommended revisions should be submitted to:

Manager, Engineering Department
National Electrical Manufacturers Association
2101 L Street, N.W.
Washington, DC 20037

NEMA Standards Publication No. TC 10-1983 revises and supersedes the publication for *Plastic Communications Duct and Fittings for Underground Installation,* Publication No. TC 10-1978. Prior to publication, the NEMA Standards, Suggested Standards for Future Design, and Authorized Engineering Information which appear in this publication unchanged since their appearance in TC 10-1978 were reaffirmed. Those which have been revised are followed by their appropriate classification and the date "9-15-1983."

Scope

These standards cover the following types of plastic communications duct and fittings having a nominal size of 3½ or 4 inches and intended for the underground installation of communication wire and cable.

Type EB—Designed for encased burial in concrete when installed (also referred to as Type I Duct).

Type DB—Designed for direct burial without encasement in concrete (also referred to as Type II Duct).

NOTE—The values stated in U.S. customary units are to be regarded as the standard.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

PVC AND ABS PLASTIC COMMUNICATIONS DUCT AND FITTINGS FOR UNDERGROUND INSTALLATION

Section 1
REFERENCED STANDARDS

In this publication, reference is made to standards listed below. Copies are available from the indicated sources.

American Society for Testing and Materials
1916 Race Street
Philadelphia, PA 19103

D 412–82a	*Definitions of Terms Relating to Plastic Piping Systems*
D 543–67 (1978)	*Resistance of Plastics to Chemical Reagents, Test for*
D 618–61 (1981)	*Conditioning Plastics and Electrical Insulating Materials for Testing*
D 648–72 (1978)	*Deflection Temperature of Plastics Under Flexural Load, Test for*
D 883–80C	*Plastics, Definitions of Terms Relating to*
D 1600–81	*Plastics, Abbreviations of Terms Relating to*
D 1784–81	*Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds, Specifications for*
D 1788–81	*Rigid Acrylonitrile-Butadiene-Styrene (ABS) Plastics, Specifications for*
D 2122–81	*Dimensions of Thermoplastic Pipe and Fittings, Determining*
D 2152–80	*Quality of Extruded Poly(Vinyl Chloride) (PVC) Pipe by Acetone Immersion, Test for*
D 2235–80	*Solvent Cement for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe and Fittings, Specifications for*
D 2412–77	*External Loading Properties of Plastic Pipe by Parallel-Plate Loading, Test for*
D 2444–80	*Impact Resistance of Thermoplastic Pipe and Fittings by Means of a Tup (Falling Weight), Test for*
D 2564–80	*Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Pipe and Fittings, Specifications for*
D 3138–80	*Solvent Cements for Transition Joints Between Acrylonitrile-Butadiene-Styrene (ABS) and Poly(Vinyl Chloride) (PVC) Non-Pressure Piping Components, Specifications for*
F 402–80	*Safe Handling of Solvent Cements Used for Joining Thermoplastic Pipe and Fittings, Recommended Practice for*

National Electrical Manufacturers Association
2101 L Street, N.W.
Washington, DC 20037

TC 8-1978	*Extra-strength Plastic Utilities Duct for Underground Installation*

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Section 2
GENERAL

2.1 DEFINITIONS AND ABBREVIATIONS

Definitions for plastic communications duct and fittings shall be in accordance with ASTM D 883, or ASTM F 412, or both, and abbreviations shall be in accordance with ASTM D 1600, unless otherwise specified.

NEMA Standard 7-12-1978.

2.2 MATERIALS

2.2.1 Duct and Fittings

Plastic communication duct and fittings shall be made from:

1. Poly(Vinyl-Chloride) (PVC) plastic compound which meets cell classification PVC-12154, A, B, or C (with a minimum tensile strength of 4000 psi) as defined in ASTM D 1784*; or

NEMA Standard 1-12-1984.

2. Acrylonitrile-butadiene-styrene (ABS) plastic compound which meets cell classification ABS 1-2-3 as defined in ASTM D 1788.†

NEMA Standard 7-12-1978.

Reworked material may be used, provided that the duct or fittings produced meet all of the requirements of these standards.

Authorized Engineering Information 7-12-1978.

2.2.2 Solvent Cements

PVC solvent cements, in accordance with ASTM D 2564 should be used with PVC systems. ABS solvent cements, in accordance with ASTM D 2235, should be used with ABS systems.

NOTE—Combination solvent cements, in accordance with ASTM D 3138, are available for joining PVC to ABS. ASTM F 402 is referenced as recommended practice for safe handling of solvent cements.

Authorized Engineering Information 7-12-1978.

2.2.3 Compound Heat Distortion

The minimum heat distortion temperature shall be 158°F (70°C) for PVC and 179.6°F (82°C) for ABS when tested in accordance with ASTM D 648.

NEMA Standard 7-12-1978.

*PVC homopolymer compounds that have different cell classifications because one or more properties are superior to those listed above may also be used.

†ABS compounds that have different cell classifications because one or more properties are superior to those listed above may also be used.

2.3 NOMINAL SIZES

The nominal sizes of duct and fittings shall be 3 ½ and 4 inches.

NOTE—For other sizes with comparable performance characteristics, see the NEMA Standards Publication No. TC 8 (this note is classified as Authorized Engineering Information 9-25-1983).

NEMA Standard 9-25-1975.

2.4 DIMENSIONS

2.4.1 Measurement

Dimensions shall be measured in accordance with ASTM D 2122, unless otherwise specified.

2.4.2 Duct Dimensions

1. *Diameter, Out-of-roundness and Wall Thickness*—Dimensions shall be in accordance with Table 2-1.

NEMA Standard 9-15-1983.

2. *Duct Length*—The laying length, excluding the belled end or coupling, shall be 20 ft ± 1 in (609.6 ± 25.4 mm) unless otherwise specified.

NEMA Standard 9-15-1983.

3. *Average Outside Diameter*—The average outside diameter at any cross section on the length of the duct shall be determined by the use of a vernier circumferential wrap tape in accordance with Section 6.2.2 of ASTM D 2122.

4. *Out-of-Roundness*—Out-of-roundness shall be computed by obtaining the minimum and maximum diameters of a cross section of the duct. The difference between the minimum and maximum measurements shall not exceed the tolerance shown in Table 2-1. The out-of-roundness tolerance in Table 2-1 shall apply only at the the point of manufacture.

5. *Wall Thickness*—The wall thickness of duct shall be in accordance with the requirements of Table 2-1.

2.4.3 Belled End Dimensions

1. *Dimensions*—The dimensions of integral belled ends shall conform to the requirements of Table 2-2.

2. *Centering*—Belled ends shall be centered to provide a visible shoulder around the entire circumference of the duct.

3. *Wall Thickness*—The wall thickness of an integral bell shall be considered satisfactory if formed from duct which meets the requirements of these standards.

NEMA Standard 7-12-1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS


Table 2-1
DUCT DIMENSIONS

Nominal Duct Size, Inches	Outside Diameter			Minimum Wall Thickness*						Minimum Inside Diameter in (mm)
				Type EB-30		Type EB-40		Type DB-120		
	Average Diameter in (mm)	Average Diameter Tolerance in (mm)	Total Allowed Out-of-roundness in (mm)	ABS in (mm)	PVC in (mm)	ABS in (mm)	PVC in (mm)	ABS in (mm)	PVC in (mm)	
3½	3.830 (97.28)	±0.005 (±0.13)	0.050 (1.27)	0.089 (2.26)	0.079 (2.01)	0.099 (2.52)	0.088 (2.24)	0.145 (3.68)	0.129 (3.28)	3.450 (87.63)
4	4.350 (110.49)	±0.005 (±0.13)	0.050 (1.27)	0.102 (2.59)	0.091 (2.31)	0.114 (2.90)	0.101 (2.57)	0.166 (4.22)	0.145 (3.76)	3.930 (99.82)

NEMA Standard 9-15-1983.

* The relationship between these minimum wall thicknesses and performance is based on compounds having a modulus of elasticity of 500,000 psi (3447 MPa) for PVC, and 360,000 psi (2482 MPa) for ABS. Other compounds might require greater wall thicknesses to meet the performance requirements of these standards.

Table 2-2
BELLED END DIMENSIONS

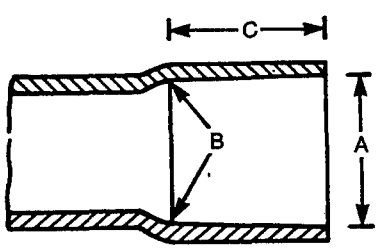

Nominal Duct Size, Inches	A Socket Entrance Inside Diameter			B Socket Bottom Inside Diameter			C Socket Depth
	Average Diameter in (mm)	Average Diameter Tolerance in (mm)	Total Out-of-roundness in (mm)	Average Diameter in (mm)	Average Diameter Tolerance in (mm)	Total Out-of-roundness in (mm)	in (mm)
3½	3.855 (97.92)	±0.005 (±0.13)	0.050 (1.27)	3.835 (97.41)	±0.005 (±0.13)	0.050 (1.27)	2.75+0.25–0 (69.9+6.4–0)
4	4.380 (111.25)	±0.005 (±0.13)	0.050 (1.27)	4.355 (110.62)	±0.005 (±0.13)	0.050 (1.27)	3.00+0.25–0 (76.2+6.4–0)

NEMA Standard 7-12-1978.

NOTE—Metal circular Go No-Go plug gages machined to the minimum and maximum inside diameters may be used to check dimensions A and B. These gages are detailed in Appendix A.

Not for Resale

TC 10-83
6470247 0004205 6

2.4.4 Fitting Dimensions

1. Fitting dimensions shall be in conformance with the applicable table in this standard.

2. The belled ends on fabricated fittings shall conform to the requirements of Table 2-2.

3. Fabricated fittings, including bends and sweeps, shall be made from duct or sleeve stock that meets all of the dimensional and physical requirements of the specification.

NEMA Standard 7-12-1978.

2.5 WORKMANSHIP

Duct and fittings shall be homogeneous throughout and free from visible cracks, holes, burrs, foreign inclusions, or other defects which could damage cables.

NEMA Standard 9-25-1975.

2.6 INSPECTION

Duct and fittings shall be inspected at the point of manufacture for compliance with the dimensional and performance requirements of these standards and for freedom from defects as defined in 2.5.


NEMA Standard 9-25-1975.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Table 2-3
FITTING SOCKETS

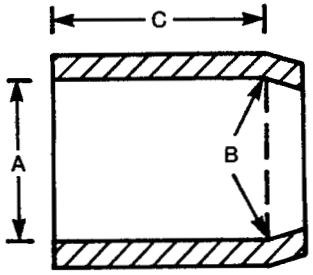

Nominal Size Inches	Dimensions				
	A Socket Entrance Inside Diameter		B Socket Bottom Inside Diameter		C Socket Depth
	Average Inside Diameter in (mm)	Out-of-roundness in (mm)	Average Inside Diameter in (mm)	Out-of-roundness in (mm)	in (mm)
3 1/2	3.855±0.005 (97.92±0.13)	±0.050 (±1.27)	3.835±0.005 (97.41±0.13)	±0.050 (±1.27)	2.75+0.250–0 (69.9+6.4–0)
4	4.380±0.005 (111.25±0.13)	±0.050 (±1.27)	4.355±0.005 (110.62±0.13)	±0.050 (±1.27)	3.00+0.250–0 (76.2+6.4–0)


NOTE—All fitting sockets shall be in accordance with Table 2-3 unless otherwise specified.

NEMA Standard 7-12-1978.


Not for Resale

TC 10-83 6470247 0004208 1

Table 2-4
MOLDED AND FABRICATED COUPLINGS

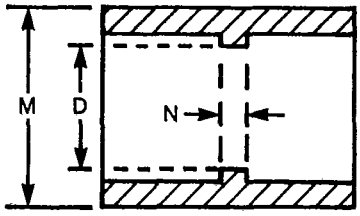

MOLDED

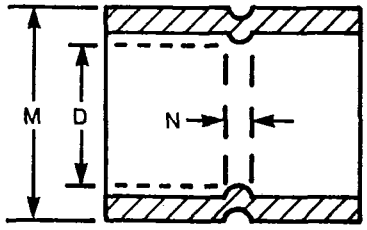


FABRICATED

Nominal Size, Inches	Dimensions M Maximum in (mm)	D Minimum in (mm)	N Minimum in (mm)
3 1/2	4 1/4 (108)	3.450 (87.63)	7/64 (2.8)
4	4 3/4 (121)	3.930 (99.82)	7/64 (2.8)


NEMA Standard 7-12-1978.

Table 2-5
SLEEVE COUPLINGS

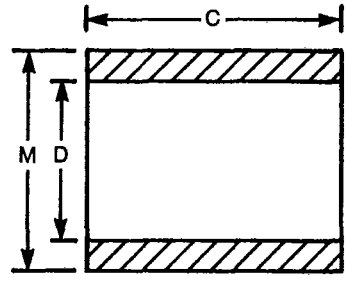

Nominal Size, Inches	Dimensions M Maximum in (mm)	C in (mm)	D in (mm)
3 1/2	4 1/4 (108)	6±1/8 (152.4±3)	3.842±0.005 (97.59±0.13)
4	4 3/4 (121)	6±1/8 (152.4±3)	4.365±0.005 (110.87±0.13)

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

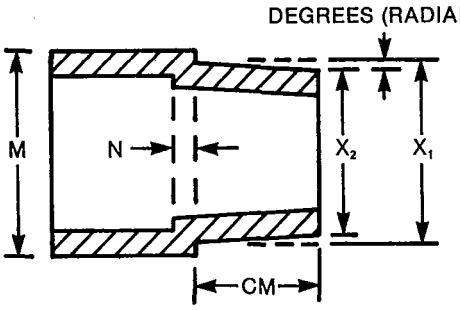

(THIS DRAWING APPLIES TO TABLES 2-6 AND 2-7)

Table 2-6
ADAPTER TO TYPE I FIBER CONDUIT COUPLING, 4 INCHES

Nominal Size, Inches	Dimensions					
	M Maximum in (mm)	N Minimum in (mm)	CM Nominal in (mm)	X_1 Nominal in (mm)	X_2 Nominal in (mm)	Degrees (Radians)
4	4 3/4 (121)	11/64 (4.4)	1 15/16 (49.2)	4 3/4 (121)	4 1/2 (114)	2 (0.035)

NEMA Standard 7-12-1978.


Table 2-7
ADAPTER TO ASBESTOS-CEMENT CONDUIT COUPLING

Nominal Size, Inches	Dimensions				
	M Maximum in (mm)	M Minimum in (mm)	CM in (mm)	X_2 in (mm)	Degrees (Radians)
3 1/2 EB a/c	4 1/4 (108)	11/64 (4.4)	1.12 (28.4)	3.90 (99)	1 3/4 (0.031)
4 EB a/c	4 3/4 (121)	11/64 (4.4)	1.25 (31.8)	4.40 (111)	1 3/4 (0.031)
3 1/2 DB a/c	4 1/4 (108)	11/64 (4.4)	1.81 (46)	4.03 (102)	1 3/4 (0.031)
4 DB a/c	4 3/4 (121)	11/64 (4.4)	2.00 (50.8)	4.52(114.8)	1 3/4 (0.031)

NEMA Standard 7-12-1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale


Table 2-8
FEMALE THREADED ADAPTERS

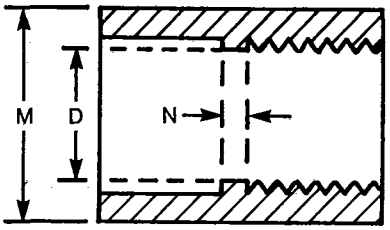

Nominal Size, Inches	Dimensions M Maximum in (mm)	D Minimum in (mm)	N Minimum in (mm)	Minimum Number of Threads
3 1/2	4 1/2 (114)	3 7/16 (87.3)	1/8 (3)	5 Full
4	5 1/8 (130)	3 15/16 (100)	1/8 (3)	5 Full

NEMA Standard 7-12-1978.

Table 2-9
CAST IRON "D" ADAPTER

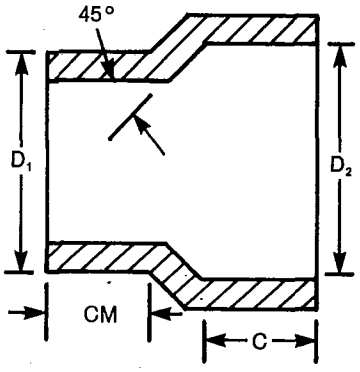


Nominal Size, Inches	Dimensions D_1 in (mm)	D_2 Nominal in (mm)	CM Nominal in (mm)	C in (mm)
4	4.350±0.005 (110.49±0.13)	5 15/32 (138.9)	3 5/8 (92.1)	3±1/8 (76.2±3)

NEMA Standard 7-12-1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Table 2-10
5° ANGLE COUPLINGS

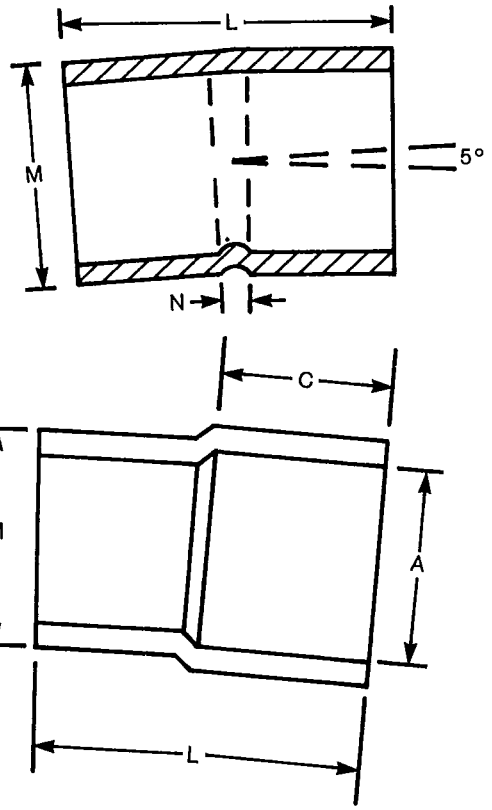


Fabricated Socket X Spigot			
	Dimensions		
Nominal Size, Inches	M Maximum in (mm)	N Minimum in (mm)	L Minimum in (mm)
3 1/2	4 1/4 (108)	7/64 (2.8)	6 (152.4)
4	4 3/4 (121)	7/64 (2.8)	6 (152.4)

NEMA Standard 7-12-1978.

Molded Socket X Spigot				
	Dimensions			
Nominal Size, Inches	A Maximum in (mm)	C Minimum in (mm)	L Maximum in (mm)	M Maximum in (mm)
4	4 3/8 (111.1)	2 (50.8)	4 1/2 (114.3)	4 3/8 (111.1)

NEMA Standard 9-15-1983.

Table 2-11
SQUARE END BELL

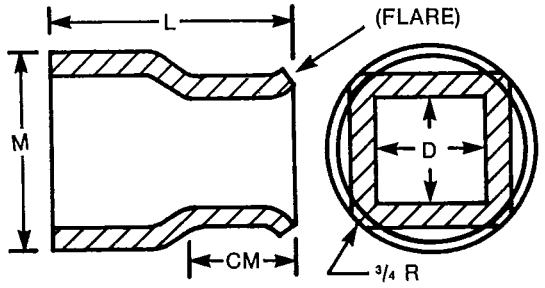


	Dimensions			
Nominal Size, Inches	M Maximum in (mm)	L Minimum in (mm)	D in (mm)	CM Minimum in (mm)
4	4 7/8 (123.8)	6(152.4)	4 1/4 ±1/8 (108.0±3)	2 1/2 (64)

NEMA Standard 9-15-1983.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale


Table 2-12
ROUND END BELL

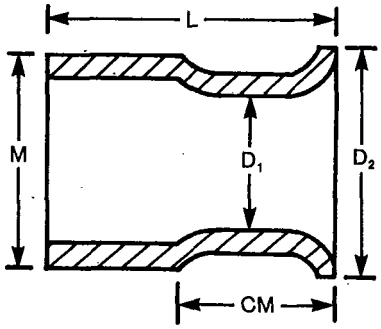

Nominal Size, Inches	Dimensions				
	M Maximum in (mm)	L Minimum in (mm)	CM Minimum in (mm)	D_1 Minimum in (mm)	D_2 Maximum in (mm)
4	4 7/8 (123.8)	6 (152.4)	2 1/2 (63.5)	3 15/16 (100)	5 3/4 (146)

NEMA Standard 9-15-1983.

Table 2-13
3 1/2 × 4 INTERNAL ROUND BORE ADAPTER

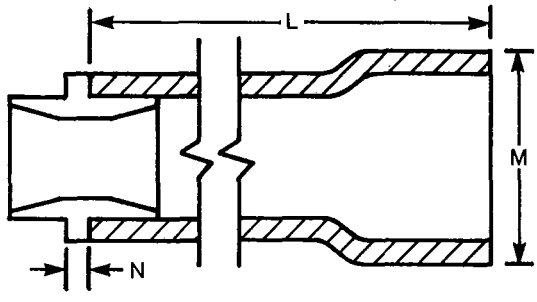


Nominal Size, Inches	Dimensions		
	M Maximum in (mm)	L Nominal in (mm)	N in (mm)
4	4 3/4 (121)	18(457.2)	3/16 (4.8)

NEMA Standard 7-12-1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS

Not for Resale


Table 2-14
INTERNAL JOINING COUPLING

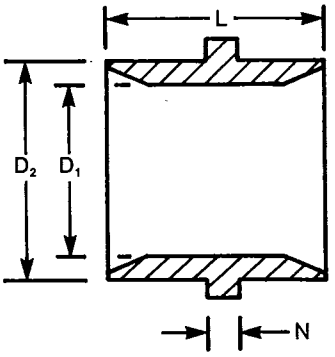

Nominal Size, Inches	Dimensions			
	D_1 Minimum in (mm)	D_2 Nominal in (mm)	N in (mm)	L Nominal in (mm)
3 1/2	3.25 (82.6)	3.50 (88.9)	3/16 (4.8)	2 1/2 (63.5)
4	3.93 (99.8)	4.00 (101.6)	3/16 (4.8)	2 15/16 (74.6)

NEMA Standard 7-12-1978.

Table 2-15
WYE BRANCH

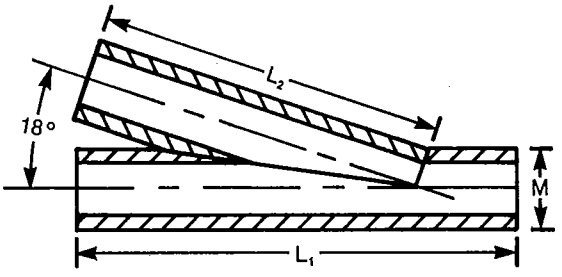


Nominal Size, Inches	Dimensions		
	M Maximum in (mm)	L_1 Minimum in (mm)	L_2 Minimum in (mm)
3 1/2	4 1/4 (108)	20 (508)	17 (432)
4	4 3/4 (121)	20 (508)	17 (432)

NOTE—Belled ends or couplings optional.

NEMA Standard 7-12-1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale


Table 2-16
SQUARE CLAY ADAPTER

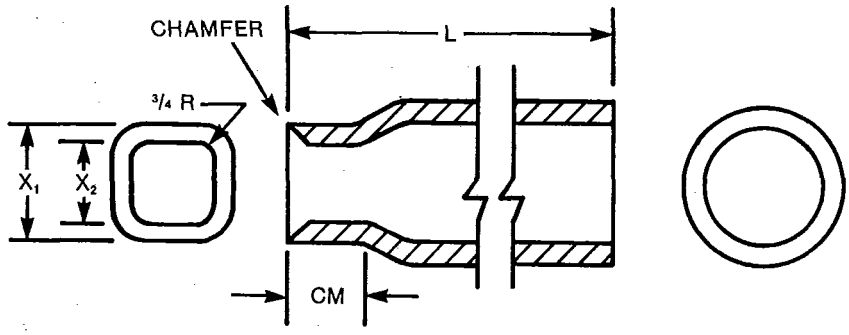

Nominal Size, Inches	Clay Size, Inches	Dimensions X_1 Maximum in (mm)	X_2 Minimum in (mm)	L Nominal in (mm)	CM Minimum in (mm)
3 1/2	3 1/4	3.38 (85.9)	3 (76)	12, 18, 24 (305, 457, 610)	3/4 (19)
3 1/2	3 1/2	3.65 (91.7)	3 1/4 (82.6)	12, 18, 24 (305, 457, 610)	3/4 (19)
4	4	3.80 (96.5)	3 3/8 (85.7)	12, 18, 24 (305, 457, 610)	3/4 (19)

Alternate Construction—May have belled end or coupling attached. NEMA Standard 7-12-1978.

Table 2-17
BENDS AND SWEEPS

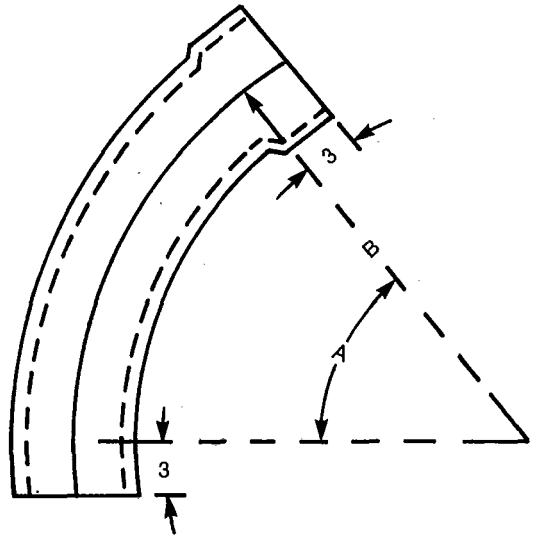


Nominal Size, Inches	Dimensions A Degree of Curvature (Radian)	B Radius of Curvature ft (cm)
3 1/2 and 4	5 (0.08)	4, 12 (120, 360)
	11 1/4 (0.196)	3, 4, 12 1/2 (90, 120, 375)
	22 1/2 (0.393)	2, 3, 4, 9, 12, 15, (60, 90, 120, 270, 360, 450)
	30 (0.524)	2, 3, 4, 6, 9, 10, 12, 15 (60, 90, 120, 180, 270, 300, 360, 450)
	45 (0.785)	2, 3, 4, 6, 9, 12 1/2, 15 (60, 90, 120, 180, 270, 375, 450)
	90 (1.571)	1 1/2, 2, 2 1/2, 3, 4, 6, 9, 10, 15 (45, 60, 75, 90, 120, 180, 270, 300, 450)

NOTE—Bends and sweeps shall be constructed from either Type EB30, EB40, or DB stock. NEMA Standard 7-12 1978.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale


Table 2-18
(FABRICATED) ADAPTER TO ASBESTOS CEMENT CONDUIT SPIGOT END

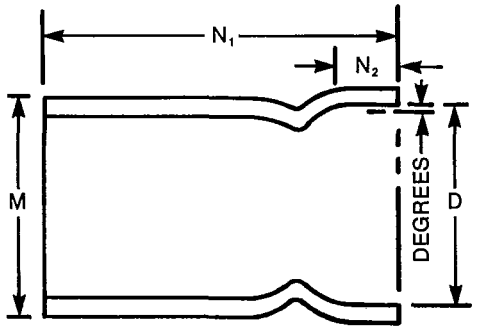

Nominal Size, Inches	Dimensions				
	M Maximum in (mm)	N_2 in (mm)	N_1 Nominal in (mm)	D in (mm)	Degrees (Radians)
3 1/2 EB a/c	4 1/4 (108)	1.12 (28.4)	5 (127)	3.94±0.005 (100.3±0.13)	1 3/4 (0.031)
4 EB a/c	4 3/4 (121)	1.25 (31.8)	6 (152.4)	4.45±0.005 (113 ±0.13)	1 3/4 (0.031)
3 1/2 DB a/c	4 1/4 (108)	1.81 (46)	5 (127)	4.09±0.005 (103.9±0.13)	1 3/4 (0.031)
4 DB a/c	4 3/4 (121)	2.00 (50.8)	6 (152.4)	4.59±0.005 (116.6±0.13)	1 3/4 (0.031)

NEMA Standard 7-12-1978.

Table 2-19
3 1/2 × 4 INCH EXTERNAL ENLARGING COUPLING

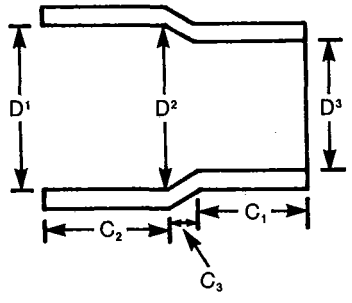

Dimensions							
C1 Maximum in (mm)	C2 Nominal in (mm)	C2 Tolerance in (mm)	C3 Nominal in (mm)	D1 Nominal in (mm)	D2 Nominal in (mm)	D3 Nominal in (mm)	D Tolerance in (mm)
3.00 (76.2)	3.00 (76.2)	+ 1/4 (6.85) −0 (0.00)	3/4 (19.05)	4.380 (111.25)	4.355 (110.62)	3.842 (97.59)	±.005 (0.13)

NEMA Standard 9-15-1983.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Section 3
REQUIREMENTS AND TEST METHODS

3.1 CONDITIONING TEST SPECIMENS AND TEST CONDITIONS

3.1.1 Referee Tests

When conditioning is required, the test specimen shall be conditioned in accordance with Procedure A in ASTM D 618 at 73.4° ± 3.6°F (23° ± 2°C) and 50 ± 5 percent relative humidity for not less than 40 hours prior to test. The 32°F (0°C) drop weight impact specimens shall be conditioned for at least 4 hours in liquid maintained at 32° to 35°F (0° to 1.6°C) unless otherwise specified.

Tests shall be conducted at 73.4° ± 3.6°F (23° ± 2°C) and 50 ± 5 percent relative humidity unless otherwise specified.

NEMA Standard 7-12-1978.

3.1.2 Quality Control

Specimens shall be conditioned for 3 hours in air, or 1 hour in liquid, at 73.4° ± 3.6°F (23° ± 2°C). The 32°F (0°C) drop impact samples shall be conditioned for one half hour in liquid maintained at 32° to 35°F (0° to 1.6°C).

Specimens shall be tested at 73.4° ± 3.6°F (23° ± 2°C) with no regard for relative humidity. The low temperature impact test equipment shall be at 73.4° ± 3.6°F (23° ± 2°C) with no regard for relative humidity.

NEMA Standard 7-12-1978.

3.2 JOINT TIGHTNESS (REFEREE TEST ONLY)

Joints shall not leak when subjected to an internal pressure of 25 psi (172 kPa), using water as the medium, for 1 hour. The joint shall be made by the method recommended by the manufacturer. Solvent cement joints shall be allowed to stand for 24 hours at room temperature prior to making the test.

NEMA Standard 7-12-1978.

3.3 EXTRUSION QUALITY

PVC ducts shall not flake or disintegrate when tested in accordance with ASTM D 2152.

NEMA Standard 9-25-1975.

3.4 HYDROCARBON RESISTANCE

The hydrocarbon resistance of ABS ducts shall be considered adequate if the duct meets the load deflection requirements specified in 3.6 after being immersed for 48 hours in heptane in accordance with ASTM D 543.

NEMA Standard 9-25-1975.

3.5 DUCT IMPACT RESISTANCE

The minimum impact resistance values for Types EB and DB underground duct shall be as shown in Table 3-1 when tested* as follows:

Five specimens, each 6 + ¼ – 0 in (152.4 + 6 – 0 mm) long, shall be tested in accordance with Section 10 of ASTM D 2444, using a 20-pound Tup B and flat plate holder B. All samples shall pass. If one fails, another five specimens shall be tested. If 9 out of 10 samples pass the test, the duct shall be considered to have met the requirements of this standard.

For the 32°F (0°C) impact test, no more than 15 seconds shall elapse from the time of removal of the specimen from the conditioning medium until completion of that test.

Table 3-1
MINIMUM IMPACT RESISTANCE—ALL SIZES

Test Temp.	Type EB-30 ft-lb (J)	Type EB-40 ft-lb (J)	Type DB-120 ft-lb (J)
73.4°F (23°C)	50 (68)	50 (68)	100 (135)
32°F (0°C)	25 (34)	25 (34)	50 (68)

NEMA Standard 9-15-1983.

3.6 DUCT STIFFNESS

The minimum duct stiffness values for Types EB and DB underground duct shall be as shown in Table 3-2 when tested as follows:

The duct stiffness (F/ΔY) shall be determined at 5 percent inside diameter deflection in accordance with ASTM D 2412.

Each specimen shall be placed so that the minimum wall thickness is uppermost (adjacent to the top bearing plate). The vertical inside diameter shall be measured before compressing the specimen.

Three specimens, each 6 ± ⅛ in (152.40 ± 3.17 mm) long, shall be cut from each sample. The specimens shall be compressed at the rate of ½ in (12.70 mm) per minute and the load recorded at the vertical deflection equivalent to 5 percent of the original inside diameter of the specimen.

The duct stiffness at 5 percent vertical deflection shall be determined as follows:

$$\text{Duct Stiffness, Pounds/Inch/Inch} = F/\Delta Y \quad \text{(Kilopascals)}$$

*This test is intended for use only as a quality control test, not as a simulated service test.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Where:

F = Load in pounds per inch of length recorded at 5 percent vertical deflection in inches.

ΔY = Vertical deflection of inside diameter in inches.

Table 3-2

Nominal Size, Inches	F/ΔY (kPa)		
	Type EB-30 (kPa)	Type EB-40 (kPa)	Type DB-120 (kPa)
All	30 (267)	40 (276)	120 (827)

NEMA Standard 9-15-1983.

3.7 MARKING

All required markings shall be legible and so applied as to remain legible under normal handling and installation practices.

Duct and fittings shall be clearly marked with the following:

1. Manufacturer's name or trademark.
2. Nominal size.
3. Material ABS or PVC.
4. NEMA TC 10.
5. EB-30, EB-40, or DB-120.
6. Any additional marking deemed necessary by the manufacturer.

Bends and sweeps shall, in addition, be marked to show the degree and radius of curvature.

NOTE—Abbreviations may be used where necessary.

NEMA Standard 9-15-1983.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Appendix A
SOCKET BOTTOM AND SOCKET ENTRANCE GO NO-GO GAGE FOR BELLED END DIMENSIONS SHOWN IN TABLE 2-2
(Authorized Engineering Information 7-12-1978)

A.1 SOCKET BOTTOM GO NO-GO GAGE


The socket bottom Go No-Go gage may be machined from ¼-in (6 mm) thick steel into a full circle gage according to the following dimensions:

Total Length of Connector, Inches	Duct Size, Inches	Go Gage		No-Go Gage	
		Diameter	Marking	Diameter	Marking
		In (mm)	In (mm)	In (mm)	In (mm)
5	3½	3.829–3.830 (97.26–97.28)	3.830 (97.28)	3.841–3.842 (97.56–97.59)	3.841 (97.56)
5	4	4.349–4.350 (110.46–110.49)	4.350 (110.49)	4.361–4.362 (110.77–110.79)	4.361 (110.77)

The gage may be used on line by the operator to continually check the dimension at the bell end bottom. The Go end should go to the bottom of the socket. The No-Go end should not go to the bottom of the socket.

The Go end may be identified by green paint. The No-Go end may be identified by red paint.

The dimension of each gage may be marked on the gage.

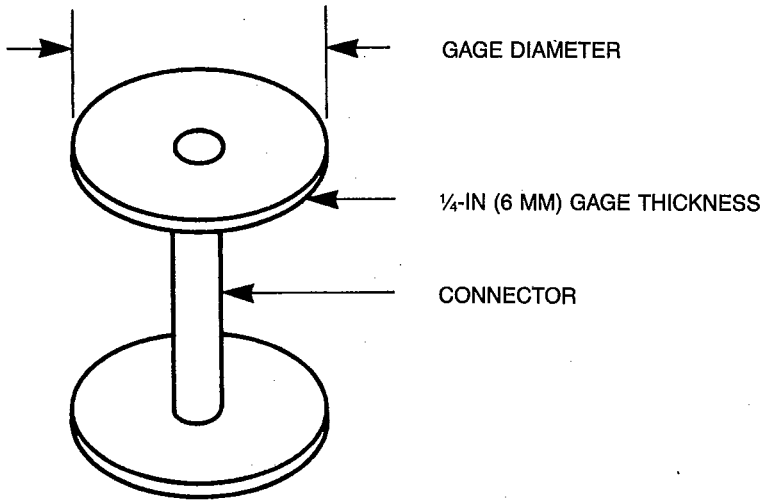

A.2 SOCKET ENTRANCE GO NO-GO GAGE

The socket entrance Go No-Go gage may be machined from ¼-in (6 mm) thick steel into a full circle gage according to the following dimensions:

Total Length of Connector, Inches	Duct Size, Inches	Go Gage		No-Go Gage	
		Diameter	Marking	Diameter	Marking
		In (mm)	In (mm)	In (mm)	In (mm)
5	3½	3.849–3.850 (97.76–97.79)	3.850 (97.79)	3.861–3.862 (98.07–98.09)	3.861 (98.07)
5	4	4.374–4.375 (110.10–111.12)	4.375 (111.12)	4.386–4.387 (111.40–111.43)	4.386 (111.40)

The gage may be used on line by the operator to continually check the dimensions of the socket entrance inside diameter.The Go end should enter the socket entrance of the bell. The No-Go end should not enter the socket entrance of the bell.

The Go end may be identified with green paint. he No-Go end may be identified with red paint.

The dimension of each gage may be marked on the gage.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

Appendix B
INSTALLATION PRACTICES

It is recommended that the products described by these standards be installed in accordance with the applicable parts of NEMA Bulletin TC B2, *Users Manual for the Installation of Underground Plastic Duct,** or in accordance with the manufacturers' recommendations.

Authorized Engineering Information 7-12-1978.

*Contact the Plastic Conduit, Duct and Accessories Section of NEMA to obtain copies of NEMA Bulletin No. TC B2.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

NEMA STANDARDIZATION

The purpose of NEMA Standards, their classification and status are set forth in certain clauses of the NEMA Bylaws, which are quoted below:

Purpose of Standards

National Electrical Manufacturers Association Standards are adopted in the public interest and are designed to eliminate misunderstandings between the manufacturer and the purchaser and to assist the purchaser in selecting and obtaining the proper product for its particular need. Existence of a National Electrical Manufacturers Association Standard does not in any respect preclude any member or nonmember from manufacturing or selling products not conforming to the standard.

(Bylaw—Art. V, Sec. 1)

Definition of a Standard

A standard of the National Electrical Manufacturers Association defines a product, process or procedure with reference to one or more of the following: nomenclature, composition, construction, dimensions, tolerances, safety, operating characteristics, performance, rating, testing, and the service for which they are designed.

(Bylaw—Art. V, Sec. 2, Subsection A)

Dimensions

Where dimensions are given for interchangeability purposes, alternate dimensions satisfying the other provisions of the standards publication may be capable of otherwise equivalent performance.

(NEMA Policy Memorandum 84-2, dated June 7, 1984)

Classes of Standards

National Electrical Manufacturers Association Standards are of two classes:

1. NEMA Standard, which relates to a product commercially standardized and subject to repetitive manufacture, which standard has been approved by at least 90 percent of the members of the Subdivision eligible to vote thereon;
2. Suggested Standard for Future Design, which may not have been regularly applied to a commercial product, but which suggests a sound engineering approach to future development, which standard has been approved by at least two-thirds of the members of the Subdivision eligible to vote thereon.

(Bylaw—Art. V, Sec. 2, Subsection B)

Authorized Engineering Information

Authorized Engineering Information consists of explanatory data and other engineering information of an informative character not falling within the classification of NEMA Standard or Suggested Standard for Future Design.

(Bylaw—Art. V, Sec. 6, 1st Sentence)

Official Standards Proposal

An Official Standards Proposal is an official draft of a proposed standard which is formally recommended to an outside organization(s) for consideration, comment and/or approval.

(Bylaw—Art. V, Sec. 4, Subsection A)

Identification of Status

Standards in NEMA Standards Publications are identified in the foreword or following each standard as "NEMA Standard" or "Suggested Standard for Future Design." These indicate the status of the standard. These words are followed by a date which indicates when the standard was adopted in its present form by the Association.

The material identified as "Authorized Engineering Information" and "Official Standards Proposal" is designated similarly.

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale

PLASTIC CONDUIT, DUCT AND ACCESSORIES SECTION

OF THE

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION

MEMBER COMPANIES

Can-Tex Industries
Mineral Wells, TX 76067

Carlon, Electrical Sciences, Inc.
Cleveland, OH 44122

Certainteed Corporation
Valley Forge, PA 19482

Challenger Electrical Materials, Inc.
Parkersburg, WV 26101

Formex Manufacturing, Inc.
Atlanta, GA 30362

Hercules Incorporated
Wilmington, DE 19899

Koch Fiberglass Products Company
Wichita, KS 67217

Midwest Plastic Fabricators, Inc.
Chagrin Falls, OH 44022

NVF Company
Fiberglass Tubular Division
Houston, TX 77038

Robroy Industries, Inc.
Verona, PA 15147

A.O. Smith-Inland, Inc.
Little Rock, AR 72209

Underground Devices, Inc.
Glenview, IL 60025

Underground Products, Inc.
Troy, MI 48099–3230

Copyright National Electrical Manufacturers Association
Provided by IHS under license with NEMA
No reproduction or networking permitted without license from IHS
Not for Resale